


Managing safety and environmental risks on Line 21 (Tuggerah – Sydney North)

RIT-T Project Assessment Conclusions Report

Region: Newcastle and Central Coast

Date of issue: 10 December 2021

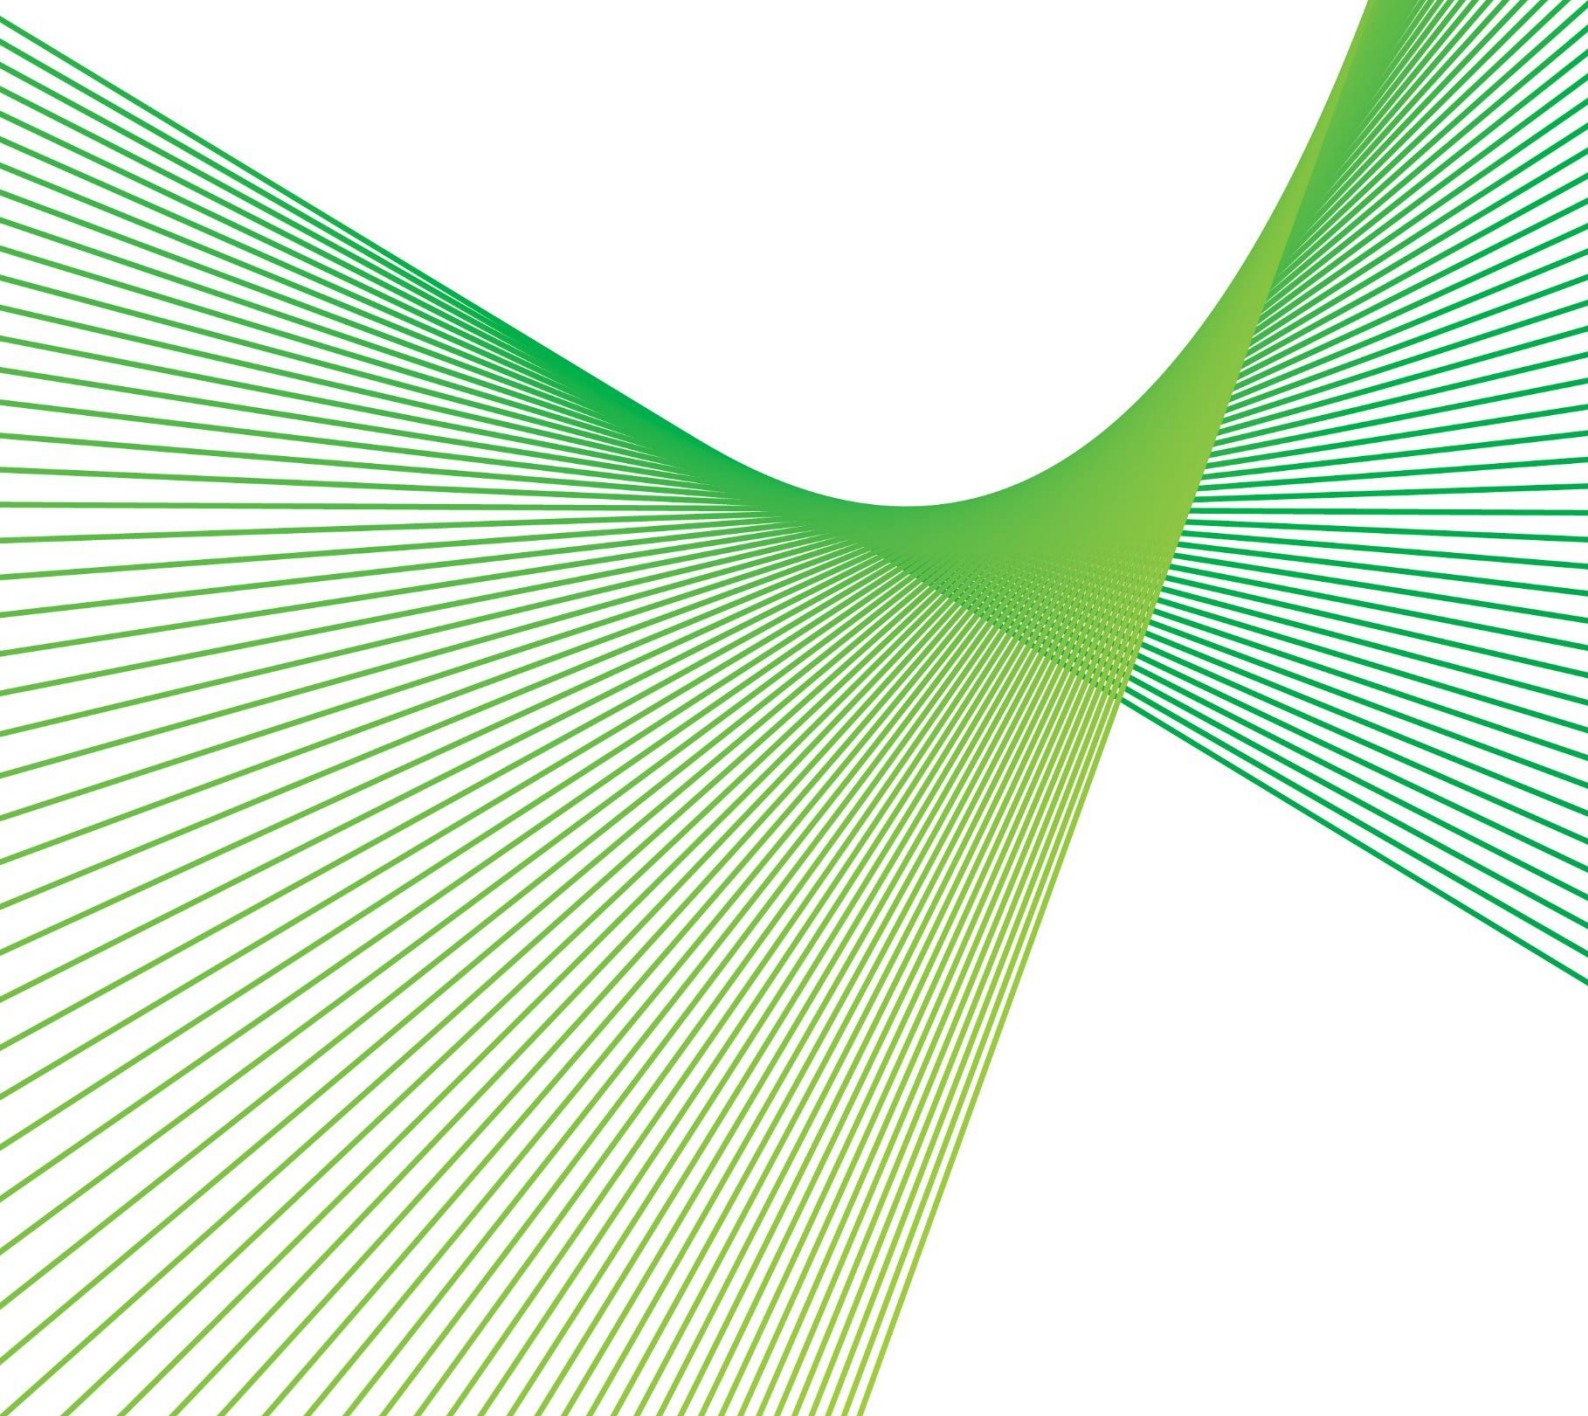

Disclaimer

This suite of documents comprises Transgrid's application of the Regulatory Investment Test for Transmission (RIT-T) which has been prepared and made available solely for information purposes. It is made available on the understanding that Transgrid and/or its employees, agents and consultants are not engaged in rendering professional advice. Nothing in these documents is a recommendation in respect of any possible investment.

The information in these documents reflect the forecasts, proposals and opinions adopted by Transgrid at the time of publication, other than where otherwise specifically stated. Those forecasts, proposals and opinions may change at any time without warning. Anyone considering information provided in these documents, at any date, should independently seek the latest forecasts, proposals and opinions.

These documents include information obtained from the Australian Energy Market Operator (AEMO) and other sources. That information has been adopted in good faith without further enquiry or verification. The information in these documents should be read in the context of the Electricity Statement of Opportunities, the Integrated System Plan published by AEMO and other relevant regulatory consultation documents. It does not purport to contain all of the information that AEMO, a prospective investor, Registered Participant or potential participant in the National Electricity Market (NEM), or any other person may require for making decisions. In preparing these documents it is not possible, nor is it intended, for Transgrid to have regard to the investment objectives, financial situation and particular needs of each person or organisation which reads or uses this document. In all cases, anyone proposing to rely on or use the information in this document should:

1. Independently verify and check the currency, accuracy, completeness, reliability and suitability of that information
2. Independently verify and check the currency, accuracy, completeness, reliability and suitability of reports relied on by Transgrid in preparing these documents
3. Obtain independent and specific advice from appropriate experts or other sources.

Accordingly, Transgrid makes no representations or warranty as to the currency, accuracy, reliability, completeness or suitability for particular purposes of the information in this suite of documents.

Persons reading or utilising this suite of RIT-T-related documents acknowledge and accept that Transgrid and/or its employees, agents and consultants have no liability for any direct, indirect, special, incidental or consequential damage (including liability to any person by reason of negligence or negligent misstatement) for any damage resulting from, arising out of or in connection with, reliance upon statements, opinions, information or matter (expressed or implied) arising out of, contained in or derived from, or for any omissions from the information in this document, except insofar as liability under any New South Wales and Commonwealth statute cannot be excluded.

Privacy notice

Transgrid is bound by the *Privacy Act 1988 (Cth)*. In making submissions in response to this consultation process, TransGrid will collect and hold your personal information such as your name, email address, employer and phone number for the purpose of receiving and following up on your submissions.

Under the National Electricity Law, there are circumstances where Transgrid may be compelled to provide information to the Australian Energy Regulator (AER). Transgrid will advise you should this occur.

Transgrid's Privacy Policy sets out the approach to managing your personal information. In particular, it explains how you may seek to access or correct the personal information held about you, how to make a complaint about a breach of our obligations under the Privacy Act, and how Transgrid will deal with complaints. You can access the Privacy Policy here (<https://www.transgrid.com.au/Pages/Privacy.aspx>).

Executive summary

Transgrid is applying the Regulatory Investment Test for Transmission (RIT-T) to options for mitigating safety and environmental risks caused by the deteriorating condition of Line 21. Publication of this Project Assessment Conclusions Report (PACR) represents the final step in the RIT-T process.

Spanning a route of 65 km, Line 21 is a 330 kV transmission line that runs between Tuggerah and Sydney North substations. It was originally built in 1959 as part of a double circuit 132 kV line from Sydney North to Dora Creek, but was upgraded to single circuit 330 kV and turned in to Munmorah in 1962, and a tee to Tuggerah added in 1986 at Sterland¹. This RIT-T is being undertaken to address environmental and safety risks on a portion of this original section of Line 21 – between the Tuggerah cut-in and Sydney North substation. This section of the line is comprised of 113 steel towers and spans approximately 51 km.

Line 21 is a key link between the Central Coast and Sydney metropolitan area and will continue to play a central role in supporting the flow of energy to take advantage of naturally-diverse weather patterns, and in the safe and reliable operation of the power system throughout and after the transition to a low-carbon electricity future.

The transmission line mainly traverses semi-urban and forested areas.

Condition issues that will impact the safe and reliable operation of the network have been found on the line. These raise a number of risks associated with asset failure, including safety and environmental (bushfire) risks.

Table E-1 Condition issues along Line 21 and their consequences

Issue	Consequences if not remediated
Corrosion of tower steel members	Steel corrosion, particularly of critical members, can lead to structural failure of tower Delaying these works can result in refurbishment being less effective or no longer being possible. Resulting in increased lifetime management costs or the need to build an entire new structure.
Corroded fasteners	Structural failure
Corroded insulators and conductor attachment fittings	Conductor drop
Corrosion of earth wire and earthwire attachment fittings	Public safety risk increase in case of fault
Corroded earth straps	Increased step/touch potentials – electric shock Decreased line reliability during lightning
Conductor and earthwire vibration dampers	Accelerated conductor fatigue due to vibration
Condition of conductor spacers	Damaged spacers can lead to conductor clashing
Buried legs and ground level steel corrosion (Includes grillage)	Foundation failure
Corroded tower ladders	Failure whilst climbing, worker injury.

¹ Location of Tuggerah cut-in at Palm Cove

Issue	Consequences if not remediated
Climbing deterrent condition	Increased exposure to unauthorised climbing
Asbestos paint	Worker or public exposure to hazardous substance.

As the asset condition deteriorates over time, the likelihood of failure and subsequent risks will increase should these issues not be addressed.

Identified need: managing safety and environmental risks from corrosion on Line 21

The proposed investment will enable Transgrid to manage safety and environmental risks on Line 21. Options considered under this RIT-T have been assessed relative to a base case. Under the base case, no proactive capital investment is made and the condition of Line 21 will continue to deteriorate.

Further deterioration of the condition of the affected assets due to corrosion would mean an increase in bushfire and safety risks along Line 21 as the likelihood of failure increases. If left untreated, corrosion of some of the vital components of the steel towers could result in incidents such as conductor drop and tower collapse. Such incidents could have serious safety consequences for nearby residents and members of the public, as well as Transgrid field crew members who may be working on or near the assets.

Transgrid manages and mitigates bushfire and safety risk to ensure they are below risk tolerance levels or 'As Low As Reasonably Practicable' ('ALARP'), in accordance with Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS).²

The proposed investment will enable Transgrid to continue to manage and operate this part of the network to a safety and risk mitigation level of ALARP. Consequently, it is considered a reliability corrective action under the RIT-T. A reliability corrective action differs from a 'market benefits'-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

No submissions received in response to Project Specification Consultation Report

Transgrid published a Project Specification Consultation Report (PSCR) on 26 July 2021 and invited written submissions on the material presented within the document. No submissions were received in response to the PSCR.

No material developments since publication of the PSCR

No additional credible options were identified during the consultation period following publication of the PSCR.

The following changes have occurred since the PSCR which have not made an impact on the preferred option:

- the cost estimate for Option 1 has been adjusted to reflect the latest estimated resource requirements. This resulted in a decrease to the total cost estimate from \$19.6m to \$16.7m, and

² Transgrid's ENSMS follows the International Organization for Standardization's ISO31000 risk management framework which requires following hierarchy of hazard mitigation approach

- adjusted phasing of risk cost benefits to align with the Option 1 commissioning timeframe.

Option 1 remains the preferred option at this stage of the RIT-T process.

Transgrid considers refurbishing Line 21 is the only credible option

Transgrid put forward for consideration one technically and commercially feasible option³: refurbishing the existing line by remediating or replacing the identified components. This option (Option 1) involves the refurbishment of Line 21 including replacement of asset components, earthwire, remediation of steelwork and foundations.

The primary driver for the identified need is to mitigate bushfire and safety risks associated with condition issues on Line 21 caused by corrosion. Two other options to address the need were considered but were not progressed further as they were determined technically or commercially non-feasible when assessed against the preferred option. These are summarised in the following table.

Transgrid expects coronavirus (COVID-19) to impact its suppliers and disrupt their supply chains, although at this time the extent of the current or future impact is unknown. Consequently, some of the costs and timing associated with the works outlined in this document may be affected.

All costs presented in this PACR are in 2021/22 dollars.

Table E-2 Options considered

Option	Description	Capital costs (\$m 2021/22)	Operating costs (\$ per year)	Remarks
Option 1	Line refurbishment	16.7 (+/- 25%)	41,000	Most economical and preferred option
Option 2	Line dismantling	~ 19.2	0	Not progressed due to technical infeasibility. Dismantling Line 21 will reduce the supply capability from the Northern NSW network to Greater Sydney and Tuggerah significantly, which may lead to reliability of supply issues.
Option 3	New transmission line from Tuggerah cut-in to Sydney North substation	> 150	Not considered	Due to significant costs of this option, a new 330 kV transmission line from Tuggerah cut-in to Sydney North substation is not commercially feasible.

³ As per clause 5.15.2(a) of the NER.

Non-network options are not able to assist in this RIT-T

Transgrid does not consider non-network options to be commercially and technically feasible to assist with meeting the identified need for this RIT-T, as non-network options will not mitigate the safety and environment risk posed as a result of corrosion-related asset deterioration.

Conclusion: refurbishment of Line 21 is optimal

The optimal commercially and technically feasible option presented in this PACR – Option 1 (line refurbishment) – is the preferred option to meet the identified need.

Moving forward with this option is the most prudent and economically efficient solution to manage and mitigate safety and environmental risk to ALARP. Consequently, it will ensure Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS) are met.

The estimated capital expenditure associated with this option is \$16.7 million +/- 25 per cent. Routine operating and maintenance costs relating to planned checks by Transgrid field crew are approximately \$41,000 per year – similar to the cost under the base case. Transgrid calculates that the avoided risk cost by undertaking Option 1 is approximately \$27.3 million per year.

This preferred option, Option 1, is found to have positive net benefits under all scenarios investigated and on a weighted basis will deliver \$307 million in net economic benefits. Transgrid also conducted sensitivity analysis on the net economic benefit to investigate the robustness of the conclusion to key assumptions. Transgrid finds that under all sensitivities, positive net benefits are expected from refurbishing Line 21.

The works will be undertaken between 2020/21 and 2022/23. Planning and procurement (including completion of the RIT-T) commenced in 2020/21 and is due to conclude in 2021/22, while project delivery and construction will occur in 2022/23.

All works will be completed in accordance with the relevant standards by 2022/23 with minimal modification to the wider transmission assets. Necessary outages of affected line(s) in service will be planned appropriately in order to complete the works with minimal impact on the network.

The analysis undertaken and the identification of Option 1 as the preferred option satisfies the RIT-T. Option 1 is the preferred option in accordance with NER clause 5.16.1(b) because it is the credible option that maximises the net present value of the net economic benefit to all those who produce, consume and transport electricity in the market. This preferred option, Option 1, was found to have the highest net economic benefit or least lifecycle cost while also maintaining compliance with regulatory and safety obligations. Transgrid also conducted sensitivity analysis on the net economic benefit to investigate the robustness of the conclusion to key assumptions. Transgrid finds that under all sensitivities, Option 1 delivers the most net benefit.

Next steps

This PACR represents the third and final step of the consultation process in relation to the application of the Regulatory Investment Test for Transmission (RIT-T) process undertaken by Transgrid. It follows a Project Specification Consultation Report (PSCR) released in July 2021. No submissions were received in response to the PSCR.

The second step, production of a Project Assessment Draft Report (PADR), was not required as Transgrid considers its investment in relation to the preferred option to be exempt from that part of the RIT-T process under NER clause 5.16.4(z1). Production of a PADR is not required⁴ due to:

- the estimated capital cost of the proposed preferred option being less than \$43 million;
- the PSCR stating:
 - the proposed preferred option (including reasons for the proposed preferred option)
 - the RIT-T is exempt from producing a PADR
 - the proposed preferred option and any other credible option will not have material market benefits⁵ except for voluntary load curtailment and involuntary load shedding
- the RIT-T proponent considers that there were no PSCR submissions identifying additional credible options that could deliver a material market benefit; and
- the PACR addressing any issues raised in relation to the proposed preferred option during the PSCR consultation.

Parties wishing to raise a dispute notice with the AER may do so prior to 12 January 2022 (30 days after publication of this PACR⁶). Any dispute notices raised during this period will be addressed by the AER within 40 to 120 days, after which the formal RIT-T process will conclude.

Further details on the RIT-T can be obtained from Transgrid's Regulation team via RIT-TConsultations@transgrid.com.au. In the subject field, please reference 'Line 21 PACR'.

⁴ In accordance with NER clause 5.16.4(z1)(4), the exemption from producing a PADR will no longer apply if Transgrid considers that an additional credible option that could deliver a material market benefit is identified during the consultation period. No additional credible options were identified.

⁵ As per clause 5.16.1(c)(6)

⁶ Additional days have been added to cover public holidays

Contents

1. Introduction	10
1.1. Purpose of this report	10
1.2. Exemption from preparing a Project Assessment Draft Report (PADR)	10
1.3. Next steps	11
2. The identified need	12
2.1. Background to the identified need	12
2.2. Description of identified need	16
2.3. Assumptions underpinning the identified need	16
2.3.1. Deteriorating asset condition	16
2.3.2. Safety and environmental risk costs	17
3. Potential credible options	19
3.1. Base case	19
3.2. Option 1 – Line refurbishment	20
3.3. Options considered but not progressed	21
3.4. No material inter-network impact is expected	22
3.5. Non-network options	22
4. Materiality of market benefits	23
4.1. Wholesale electricity market benefits are not material	23
4.2. No other classes of market benefits are material	23
5. Overview of the assessment approach	25
5.1. Description of the base case	25
5.2. Assessment period and discount rate	25
5.3. Approach to estimating option costs	25
5.4. Three different scenarios have been modelled to address uncertainty	26
6. Assessment of credible options	27
6.1. Estimated gross benefits	27
6.2. Estimated costs	27
6.3. Estimated net economic benefits	27
6.4. Sensitivity testing	28
6.4.1. Step 1 – Sensitivity testing of the optimal timing	28
6.4.2. Step 2 – Sensitivity of the overall net benefit	29
6.5. Meeting relevant regulatory obligations	30

7. Final conclusion on the preferred option	32
Appendix A Compliance checklist	33
Appendix B Risk Assessment Methodology	34
B.1 Overview of the risk assessment methodology	34

List of Tables

Table 2-1 Condition issues along Line 21 and their consequences	16
Table 3-1 Operating expenditure breakdown under the base case (\$ 2021/22)	19
Table 3-2 Option 1 scope of works.....	20
Table 3-3 Capital expenditure breakdown under Option 1 (\$m 2021/22).....	21
Table 3-4 Operating expenditure breakdown under Option 1 (\$ 2021/22)	21
Table 3-5 Options considered but not progressed	21
Table 4-1 Reasons non-wholesale electricity market benefits are considered immaterial	23
Table 5-1 Summary of scenarios	26
Table 6-1 Estimated gross benefits from credible options relative to the base case, present value (\$m 2021/22).....	27
Table 6-2 Costs of credible options relative to the base case, present value (\$m 2021/22)	27
Table 6-3 Net economic benefits for Option 1 relative to the base case, present value (\$m 2021/22)	28

List of Figures

Figure 1-1 This PACR is the first stage of the RIT-T process	11
Figure 2-1 Current arrangements of Line 21	12
Figure 2-2 Location of Line 21 on Transgrid's network	13
Figure 2-3 Corroded conductor and earthwire fittings.....	14
Figure 2-4 Corroded earthwire	15
Figure 2-5 Rust on insulator pins	15
Figure 2-6 Corroded tower members	15
Figure 2-7 Transgrid's line risks heat map	18
Figure 6-1 Net economic benefits, present value (\$m 2021/22)	28
Figure 6-2 Optimal timing of Option 1	29
Figure 6-3 Sensitivities	30
Figure B-1 Overview of Transgrid's 'risk cost' framework	34

1. Introduction

Transgrid is applying the Regulatory Investment Test for Transmission (RIT-T) to options for mitigating safety and environmental risks caused by the deteriorating condition of Line 21, a single circuit 330 kV transmission line between Tuggerah substation and Sydney North substation.

Transgrid manages and mitigates bushfire and safety risk to ensure they are below risk tolerance levels or 'As Low As Reasonably Practicable' ('ALARP'), in accordance with Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS).⁷

The proposed investment will enable Transgrid to continue to manage and operate this part of the network to a safety and risk mitigation level of ALARP. Consequently, it is considered a reliability corrective action under the RIT-T.

1.1. Purpose of this report

The purpose of this PACR⁸ is to:

- describe the identified need
- describe and assess credible options to meet the identified need
- describe the assessment approach used
- provide details of the proposed preferred option to meet the identified need

1.2. Exemption from preparing a Project Assessment Draft Report (PADR)

Subject to additional credible options being identified during the consultation period, publication of a Project Assessment Draft Report (PADR) is not required for this RIT-T as Transgrid considers its investment in relation to the preferred option to be exempt from that part of the process under NER clause 5.16.4(z1). Production of a PADR is not required due to:

- the estimated capital cost of the proposed preferred option being less than \$43 million⁹;
- the PSCR states:
 - the proposed preferred option (including reasons for the proposed preferred option)
 - the RIT-T is exempt from producing a PADR
 - the proposed preferred option and any other credible option will not have material market benefits¹⁰ except for voluntary load curtailment and involuntary load shedding
- the RIT-T proponent considers that there were no PSCR submissions identifying additional credible options that could deliver a material market benefit; and

⁷ Transgrid's ENSMS follows the International Organization for Standardization's ISO31000 risk management framework which requires following hierarchy of hazard mitigation approach.

⁸ See Appendix A for the National Electricity Rules requirements.

⁹ Varied from \$35m to \$43m based on the AER Final Determination: Cost threshold review November 2018.14. Accessed 20 May 2020 <https://www.aer.gov.au/netw/orks-pipelines/guidelines-schemes-models-reviews/cost-thresholds-review-for-the-regulatory-investment-tests-2018>


¹⁰ As per clause 5.16.1(c)(6)

- the PACR must address any issues raised in relation to the proposed preferred option during the PSCR consultation.

1.3. Next steps

This PACR represents the third and final step of the consultation process in relation to the application of the Regulatory Investment Test for Transmission (RIT-T) process undertaken by Transgrid. It follows a Project Specification Consultation Report (PSCR) released in July 2021. No submissions were received in response to the PSCR.

Figure 1-1 This PACR is the first stage of the RIT-T process¹¹

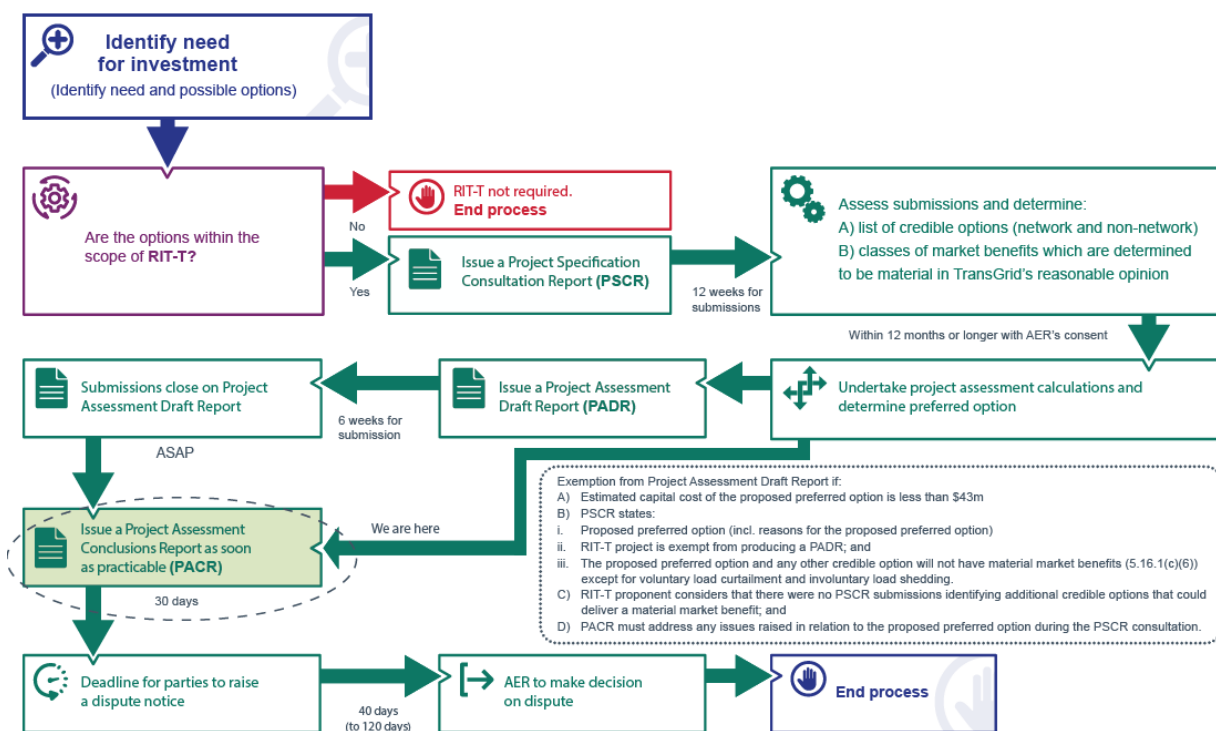

Parties wishing to raise a dispute notice with the AER may do so prior to 12 January 2022 (30 days after publication of this PACR¹²). Any dispute notices raised during this period will be addressed by the AER within 40 to 120 days, after which the formal RIT-T process will conclude.

Further details on the RIT-T can be obtained from Transgrid's Regulation team via RIT-TConsultations@transgrid.com.au. In the subject field, please reference 'Line 21 PACR'.

¹¹ Australian Energy Market Commission. "Replacement expenditure planning arrangements, Rule determination". Sydney: AEMC, 18 July 2017.65. Accessed 14 May 2020. <https://www.aemc.gov.au/sites/default/files/content/89fbf559-2275-4672-b6ef-c2574eb7ce05/Final-rule-determination.pdf>

¹² Additional days have been added to cover public holidays

2. The identified need

This section outlines the identified need for this RIT-T, as well as the assumptions and data underpinning it. It first sets out background information related to the Newcastle and Central Coast network; the Greater Sydney network; and existing electricity supply arrangements.

2.1. Background to the identified need

Spanning a route of 65 km, Line 21 is a 330 kV transmission line that runs between Tuggerah and Sydney North substations. It was originally built in 1959 as part of a double circuit 132 kV line from Sydney North to Dora Creek, but was upgraded to single circuit 330 kV and turned in to Munmorah in 1962.

It was extended to connect at Sydney East substation in 1976. That configuration of Line 21 (Munmorah - Sydney East) coincided with the establishment of Line 27 (Sydney East-Sydney North). In 1997, Line 21 was looped into Sydney North substation and Line 28 ran from Sydney North substation to Sydney East substation. The tee-connection at Tuggerah was replaced with double circuit steel poles in 2004 with the substation arrangements at Tuggerah to enable the current configuration of Line 2M (Munmorah-Tuggerah) and Line 21 (Tuggerah-Sydney North) being completed in 2008.

This RIT-T is being undertaken to address environmental and safety risks on a portion of the original section of Line 21 – between the Tuggerah cut-in and Sydney North substation. This section of the line is comprised of 113 steel towers and spans approximately 51 km.

The current arrangement of the circuits between Tuggerah and Sydney North is shown in Figure 2-1 below.

Figure 2-1 Current arrangements of Line 21


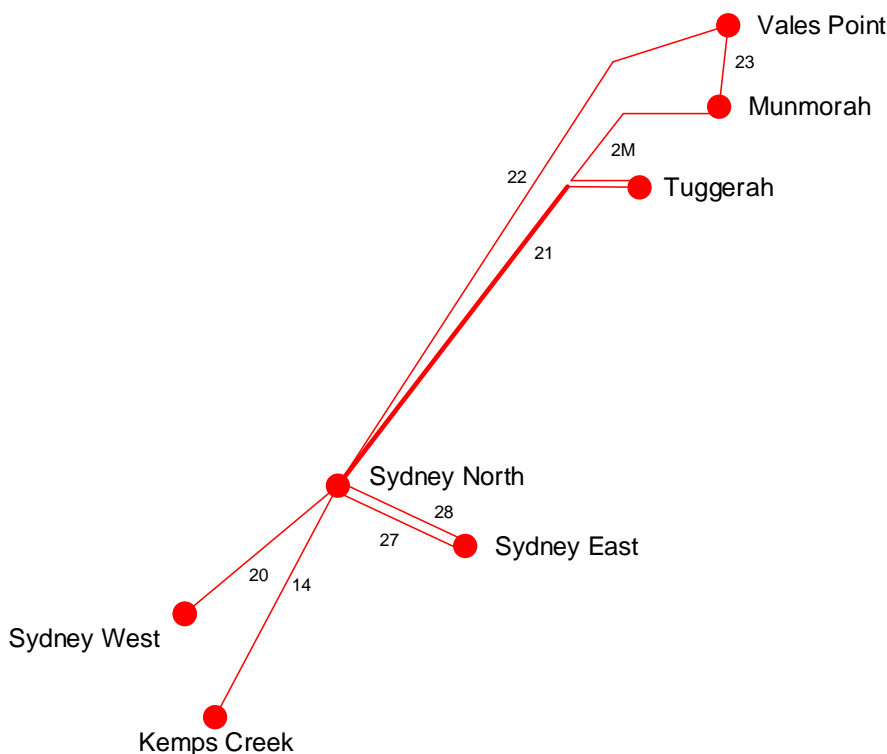


Figure 2-2 Location of Line 21 on Transgrid's network

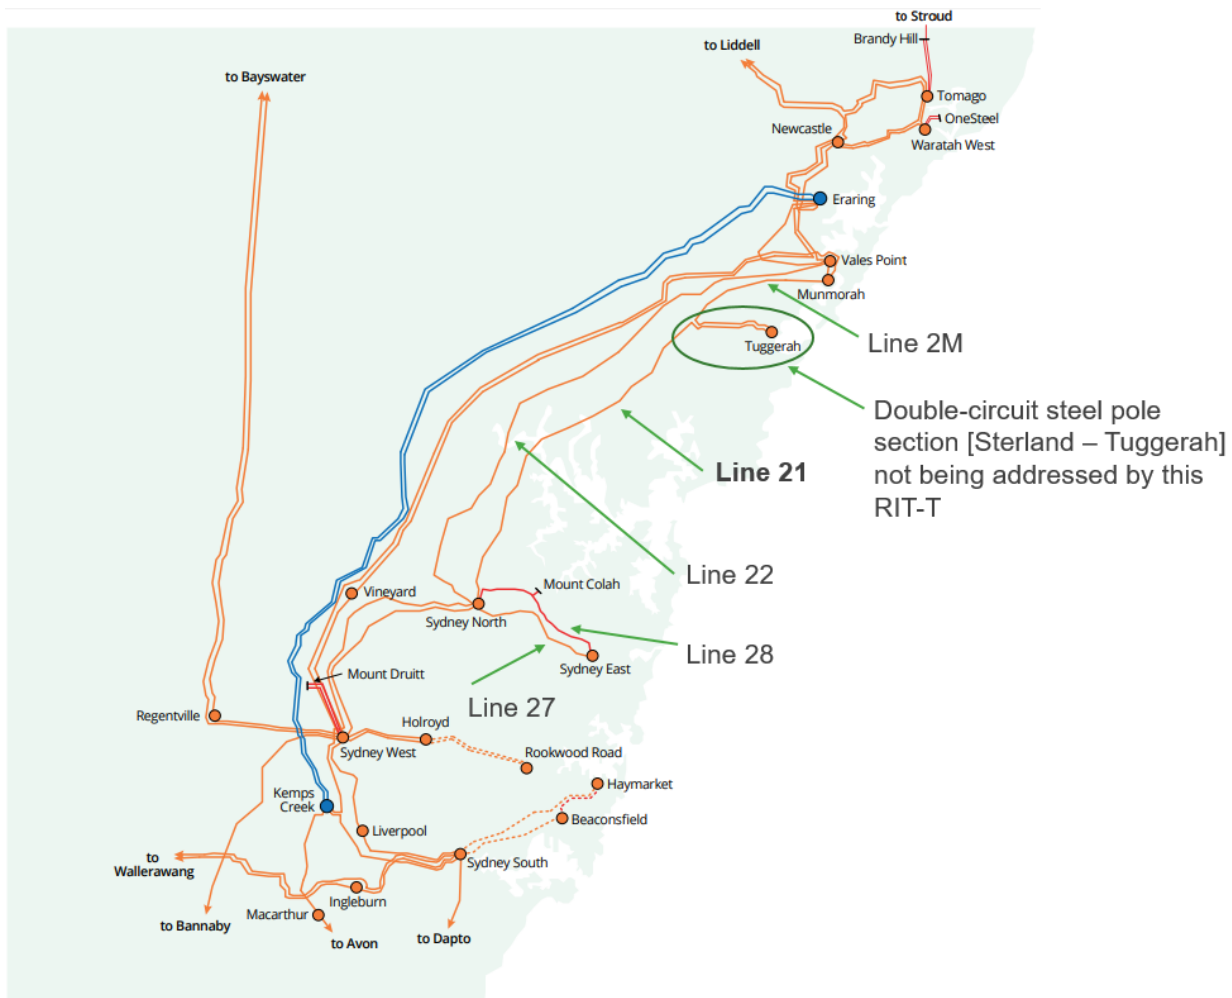

Line 21 mainly traverses semi-urban and forested areas. To the north, it connects at Tuggerah substation. A customer connection point supplying the Ausgrid network in the area inclusive of Gosford, Ourimbah, Berkeley Vale and Wyong, Line 21 supports the flow of electricity to the commercial area as well as a growing residential population of more than 340,000¹³.

This part of the network also supports a number of large industrial customers including Sydney Trains¹⁴ which is supplied at 66 kV via Ausgrid's Ourimbah subtransmission substation and a 33 kV supply at Mangrove Creek¹⁵ for water pumping¹⁶.

¹³ Population in the region is currently 343,968. Central Coast Council. "Annual Report 2019-20". Wyong: Central Coast Council, 2019.12. Accessed 9 September, 2021 https://cdn.centralcoast.nsw.gov.au/sites/default/files/Council/full-report_0.pdf

¹⁴ 10,474 Central Coast residents catch the train to work. idcommunity. "Central Coast Council area: method of travel to work," accessed 9 September, 2021. <https://profile.id.com.au/central-coast-nsw/travel-to-work>

¹⁵ Mangrove Creek Dam provides 93 percent of the region's water storage with a maximum capacity of 190,000 million litres of water. Gosford City Council. Mangrove Creek Dam. Gosford: Gosford City Council, 2012.4. Accessed 9 September 2021. https://cdn.centralcoast.nsw.gov.au/sites/default/files/Mangrove_Creek_Dam_Brochure.pdf

¹⁶ Ausgrid. *Distribution and Transmission Annual Planning Report*. Sydney: Ausgrid, 2020.35. Accessed 9 September, 2021. <https://www.ausgrid.com.au/-/media/Documents/Reports-and-Research/Network-Planning/DTA-PR-2020.pdf?la=en&hash=4B0E0E98855B22D981B572B92343A614212E0D1F>

Line 21 forms a key link between the Central Coast and the Sydney metropolitan area and supports the transmission of approximately 5 GW¹⁷ of electricity from existing generators to the NEM. To the south, it connects at Sydney North substation, a critical node in the network providing “N-1” reliability for Sydney East Bulk Supply Point (BSP) via Line 27 and 28 (Sydney North-Sydney East).

Line 21 will continue to play a central role in supporting the flow of energy to take advantage of naturally diverse weather patterns, and in the safe and reliable operation of the power system throughout and after the transition to a low-carbon electricity future.

A condition assessment performed by Transgrid in FY2017 identified a number of issues with Line 21. Further condition inspections were performed in late 2019 identified advanced condition deterioration of some line components compared to the FY2017 inspection data indicated.

A significant proportion of the steel transmission structures are impacted by various levels of deterioration and corrosion. The affected components include tower steelwork, foundations and earthing, insulators, conductor fittings, earthwire and vibration dampers, and increases the likelihood of transmission structure failures, conductor drop, and subsequent bushfire and safety risks. Of particular note is the extensive corrosion of the galvanised steel earthwire.

Figure 2-3 – Figure 2-6 below demonstrate examples of the condition of various components of Line 21

Figure 2-3 Corroded conductor and earthwire fittings



¹⁷ Summation of approximate load from generators in the area including Eraring Power Station, Vales Point Power Station, and Colongra Power Station

Figure 2-4 Corroded earthwire



Figure 2-5 Rust on insulator pins



Figure 2-6 Corroded tower members



2.2. Description of identified need

The proposed investment will enable Transgrid to manage safety and environmental risks on Line 21. Options considered under this RIT-T have been assessed relative to a base case. Under the base case, no proactive capital investment is made and the condition of Line 21 will continue to deteriorate.

Further deterioration of the condition of the affected assets due to corrosion would mean an increase in bushfire and safety risks along Line 21 as the likelihood of failure increases. If left untreated, corrosion of some of the vital components of the steel towers could result in incidents such as conductor drop and tower collapse. Such incidents could have serious safety consequences for nearby residents and members of the public, as well as Transgrid field crew members who may be working on or near the assets.

Transgrid manages and mitigates bushfire and safety risk to ensure they are below risk tolerance levels or 'As Low As Reasonably Practicable' ('ALARP'), in accordance with Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS).¹⁸

The proposed investment will enable Transgrid to continue to manage and operate this part of the network to a safety and risk mitigation level of ALARP. Consequently, it is considered a reliability corrective action under the RIT-T. A reliability corrective action differs from a 'market benefits'-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

2.3. Assumptions underpinning the identified need

Transgrid adopts a risk cost framework to quantify and value the risks and consequences of increased failure rates. Appendix B provides an overview of the Risk Assessment Methodology adopted by Transgrid.

2.3.1. Deteriorating asset condition

Assessing the condition of the line using Transgrid's Risk Cost Framework revealed that the key asset condition issues, summarised in Table 2-1, suggest accelerated deterioration of the affected assets which will result in increase in line failure rates.

Table 2-1 Condition issues along Line 21 and their consequences

Issue	Consequences if not remediated
Corrosion of tower steel members	Steel corrosion, particularly of critical members, can lead to structural failure of tower. Delaying these works can result in refurbishment being less effective or no longer being possible. Resulting in increased lifetime management costs or the need to an entire new structure.
Corroded fasteners	Structural failure
Corroded insulators and conductor attachment fittings	Conductor drop

¹⁸ Transgrid's ENSMS follows the International Organization for Standardization's ISO31000 risk management framework which requires following hierarchy of hazard mitigation approach


Corrosion of earth wire and earthwire attachment fittings	Public safety risk increase in case of fault
Corroded earth straps	Increased step/touch potentials – electric shock Decreased line reliability during lightning
Conductor and earthwire vibration dampers	Accelerated conductor fatigue due to vibration
Condition of conductor spacers	Damaged spacers can lead to conductor clashing
Buried legs and ground level steel corrosion (Includes grillage)	Foundation failure
Corroded tower ladders	Failure whilst climbing, worker injury
Climbing deterrent condition	Increased exposure to unauthorised climbing
Asbestos paint	Worker or public exposure to hazardous substance

2.3.2. Safety and environmental risk costs

Figure 2-7 below shows a heat map of transmission line risks. Transmission lines in red have the highest safety and environment risks. This has been developed based on an assessment of risk factors of specific locations.

The figure shows that Line 21 is a high risk line. The transmission line mainly traverses semi-urban and forested areas. The environmental and safety risks associated with this line are considered to be amongst the highest in Transgrid's network.

Figure 2-7 Transgrid's line risks heat map

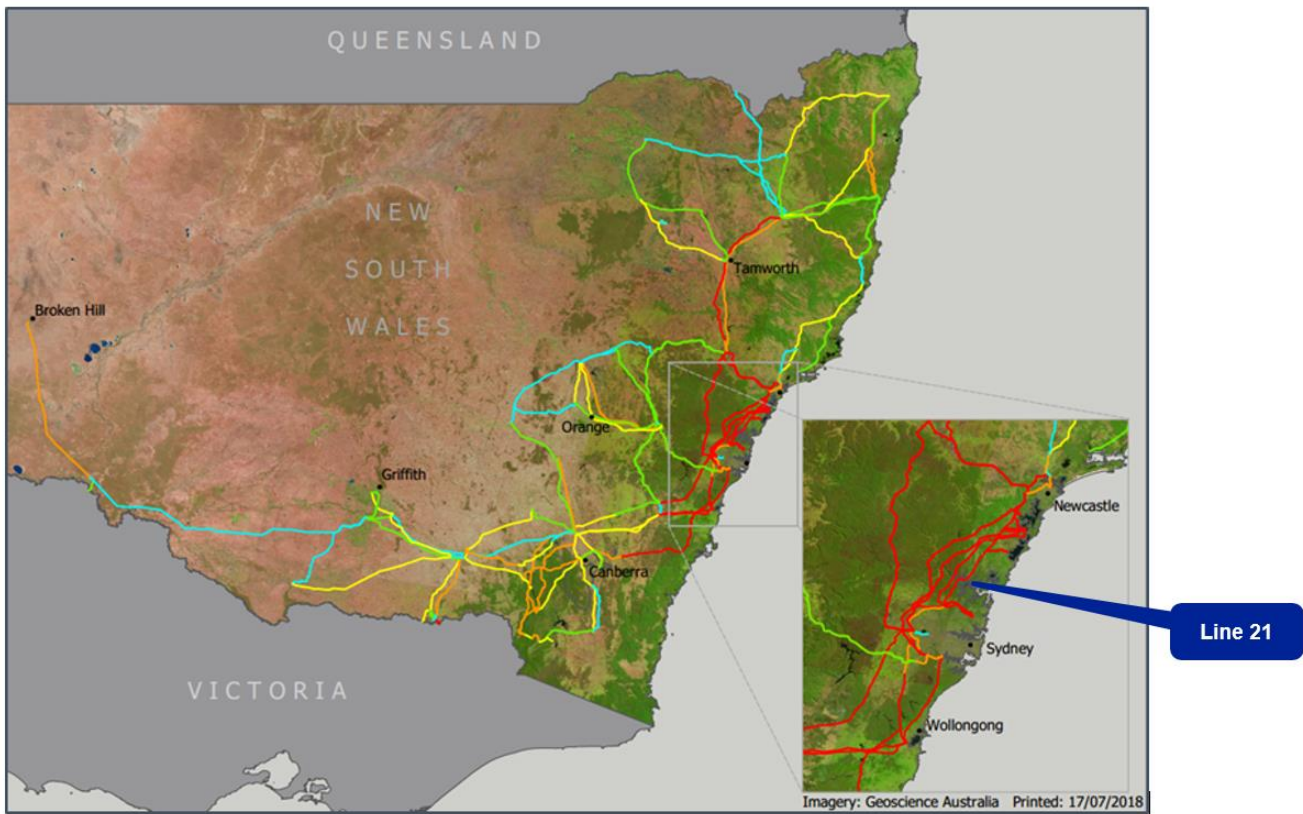

*Line colour on Figure 2-7 represent the level of risk from highest risk to lowest risk respectively: red, orange, yellow, green, and blue.

The safety and environment risk costs from the condition issues identified in Table 2-1 are approximately \$27.5 million per year. This figure will increase over time as the assets continue to deteriorate.

3. Potential credible options

This section describes the options explored by Transgrid to address the need, including the scope of each option and the associated costs. Refer to section 6.1 for benefits of each option.

Transgrid considers that there is one feasible option from a technical, commercial, and project delivery perspective which can be implemented in sufficient time to meet the identified need. Two other options were considered but not progressed for reasons for various reasons which are outlined in Table 3 5.

Transgrid expects coronavirus (COVID-19) to impact its suppliers and disrupt their supply chains, although at this time the extent of the current or future impact is unknown. Consequently, some of the costs associated with the works outlined in this document may be affected.

All costs presented in this PACR are in 2021/22 dollars.

3.1. Base case

The costs and benefits of each option in this PACR are compared against those of a base case¹⁹. Under this base case, no proactive capital investment is made to remediate the deterioration of Line 21, the line will continue to operate and be maintained under the current regime.

The regular maintenance regime will not be able to mitigate the risk of asset failure which will expose Transgrid and end-customers to approximately \$27.5 million per year in safety and environmental risk costs. The main contributor to the safety and environmental risk costs²⁰ are primarily due to the consequences of a bushfire event resulting from a conductor drop or structure failure. Under the base case, all of these risks will continue to increase as the line continues to deteriorate, and increased reactive corrective maintenance will be required to address defects and/or asset failures in order to keep the line operating at the required standard. This has not been included in the NPV analysis.

The table below provides a breakdown of the operating expenditure under the base case.

Table 3-1 Operating expenditure breakdown under the base case (\$ 2021/22)

Item	Operating expenditure (\$)
Annualised routine maintenance activities	41,000
Total operating cost	41,000 (+/-25%)

¹⁹ Transgrid notes that the December 2018 AER RIT-T Guidelines state that the base case is where the RIT-T proponent does not implement a credible option to meet the identified need, but rather continues its 'BAU activities'. The AER define 'BAU activities' as ongoing, economically prudent activities that occur in the absence of a credible option being implemented.

²⁰ This determination of yearly risk costs is based on Transgrid's Network Asset Risk Assessment Methodology and incorporates variables such as likelihood of failure/exposure, various types of consequence costs and corresponding likelihood of occurrence.

3.2. Option 1 – Line refurbishment

Option 1 involves the refurbishment of Line 21 to prevent further deterioration and corrosion to tower steelwork. Details of the scope of works under Option 1 are summarised in Table 3-2

Table 3-2 Option 1 scope of works

Issue	Remediation
Corrosion of tower steel members	Replacement of tower members and/or abrasive cleaning and painting of steelwork, nuts & bolts and structure ladders
Footing repairs	Repairs of cracked concrete footings; restoration of soil erosion including draining improvements. Works on tower leg earthworks and encasements and tower leg painting
Corroded fasteners	Replacement of fasteners
Corroded insulators and conductor attachment fittings	Replacement of complete insulator arrangement
Corrosion of earth wire and earthwire attachment fittings	Replacement of earthwire including fittings
Conductor and earthwire vibration dampers	Replacement of vibration dampers
Condition of conductor spacers	Replacement of spacers
Grillage towers (steel-soil interactions)	Replacement of end of life sacrificial anodes for towers located in nonaggressive soil Buried steel remediation and concrete encasement or micropiles for towers located in aggressive soil
Corroded tower ladders	Replacement of tower ladders
Corroded and/or ineffective climbing deterrents	Replace climbing deterrents
Asbestos paint on tower legs	Removal of asbestos paint through the use of paint strippers
Site works	Site establishment and access

The works will be undertaken between 2020/21 and 2022/23. Planning and procurement (including completion of the RIT-T) commenced in 2020/21 and is due to conclude in 2021/22, while project delivery and construction will occur in 2022/23.

All works will be completed in accordance with the relevant standards by 2022/23 with minimal modification to the wider transmission assets. Necessary outages of affected line(s) in service will be planned appropriately in order to complete the works with minimal impact on the network.

The estimated capital expenditure associated with this option is \$16.7 million +/-25%.

Table 3-3 Capital expenditure breakdown under Option 1 (\$m 2021/22)

Item	Capital expenditure (\$m)
Site establishment	1.4
Access and clearing	1.6
Insulator and fittings works	1.5
Earthwire fittings and stringing works	2.5
Steelwork, stringing, blasting and painting works	3.6
Transgrid labour and actuals	2.6
Asbestos works	0.1
Grillage works	3.4
Total capital cost	16.7 (+/- 25%)

Routine operating and maintenance costs will remain unchanged at approximately \$41,000 per year. The table below provides a breakdown. Following the remediation of condition issues, it is expected that the level of reactive corrective maintenance needed to keep the line operating at the required standard will remain in line with average historical levels. This has not been included in the NPV analysis.

Table 3-4 Operating expenditure breakdown under Option 1 (\$ 2021/22)

Item	Operating expenditure (\$)
Annualised routine maintenance activities	41,000
Total operating cost	41,000 (+/- 25%)

Following the refurbishment under this option, the risk reduction from remediating this line comes from environment and safety categories due to reduction in the likelihood of conductor drop. Transgrid calculates the annual safety, environmental and operational risk costs associated with Line 21 under Option 1 to be approximately \$0.2 million.²¹

3.3. Options considered but not progressed

Table 3-5 summarises the reasons the following credible options were not progressed further.

Table 3-5 Options considered but not progressed

Option	Description	Reason(s) for not progressing
Option 2	Line dismantling	Not progressed due to technical infeasibility. Dismantling Line 21 will reduce the supply capability from the Northern NSW

²¹ This determination of yearly risk costs is based on Transgrid's Network Asset Risk Assessment Methodology and incorporates variables such as likelihood of failure/exposure, various types of consequence costs and corresponding likelihood of occurrence.

		network to Greater Sydney and Tuggerah significantly, which may lead to reliability of supply issues.
Option 3	New transmission line from Tuggerah cut-in to Sydney North substation	Due to significant costs of this option, a new 330 kV transmission line from Tuggerah cut-in to Sydney North substation is not commercially feasible.

3.4. No material inter-network impact is expected

Transgrid has considered whether the credible option listed above is expected to have material inter-regional impact²². A ‘material inter-network impact’ is defined in the NER as:

“A material impact on another Transmission Network Service Provider’s network, which impact may include (without limitation): (a) the imposition of power transfer constraints within another Transmission Network Service Provider’s network; or (b) an adverse impact on the quality of supply in another Transmission Network Service Provider’s network.”

AEMO’s suggested screening test to indicate that a transmission augmentation has no material inter-network impact is that it satisfies the following²³:

- a decrease in power transfer capability between transmission networks or in another TNSP’s network of no more than the minimum of 3% of the maximum transfer capability and 50 MW
- an increase in power transfer capability between transmission networks or in another TNSP’s network of no more than the minimum of 3% of the maximum transfer capability and 50 MW
- an increase in fault level by less than 10 MVA at any substation in another TNSP’s network
- the investment does not involve either a series capacitor or modification in the vicinity of an existing series capacitor.

Transgrid notes that each credible option satisfies these conditions as it does not modify any aspect of electrical or transmission assets. By reference to AEMO’s screening criteria, there is no material inter-network impacts associated with any of the credible options considered.

3.5. Non-network options

Transgrid does not consider non-network options to be commercially and technically feasible to assist with meeting the identified need for this RIT-T, as non-network options will not mitigate the safety and environment risk posed as a result of corrosion-related asset deterioration. Notwithstanding, as part of this consultation process, interested parties were able to make submissions regarding non-network options that satisfy, or contribute to satisfying, the identified need.

Transgrid did not receive any responses from proponents of non-network options to the PSCR.

²² As per clause 5.16.4(b)(6)(ii) of the NER.

²³ Inter-Regional Planning Committee. “*Final Determination: Criteria for Assessing Material Inter-Network Impact of Transmission Augmentations.*” Melbourne: Australian Energy Market Operator, 2004. Appendix 2 and 3. Accessed 23 June 2021. https://aemo.com.au/-/media/files/electricity/nem/netw_ork_connections/transmission-and-distribution/170-0035-pdf.pdf

4. Materiality of market benefits

This section outlines the categories of market benefits prescribed in the National Electricity Rules (NER) and whether they are considered material for this RIT-T.²⁴

4.1. Wholesale electricity market benefits are not material

The AER has recognised that if the credible options considered will not have an impact on the wholesale electricity market, then a number of classes of market benefits will not be material in the RIT-T assessment, and so do not need to be estimated.²⁵

Transgrid determines that the credible options considered in this RIT-T will not address network constraints between competing generating centres and are therefore not expected to result in any change in dispatch outcomes and wholesale market prices. Transgrid therefore considers that the following classes of market benefits are not material for this RIT-T assessment:

- changes in fuel consumption arising through different patterns of generation dispatch
- changes in voluntary load curtailment (since there is no impact on pool price)
- changes in costs for parties other than the RIT-T proponent
- changes in ancillary services costs
- changes in network losses
- competition benefits
- Renewable Energy Target (RET) penalties.

4.2. No other classes of market benefits are material

In addition to the classes of market benefits listed above, NER clause 5.16.1(c)(4) requires Transgrid to consider the following classes of market benefits, listed in Table 4-1, arising from each credible option. Transgrid considers that none of the classes of market benefits listed are material for this RIT-T assessment for the reasons in the table below.

Table 4-1 Reasons non-wholesale electricity market benefits are considered immaterial

Market benefits	Reason
Changes in involuntary load curtailment	Since Line 21 forms part of a meshed network (N-1 redundant) required to supply Greater Sydney Region, a failure due to the corroded assets results in low chance of unserved energy.
Differences in the timing of expenditure	Options considered will provide an alternative to meeting reliability requirements but are unlikely to affect decisions to undertake unrelated expenditure in the network. Consequently, material market benefits will neither be gained nor lost due to changes in the timing of expenditure from any of the options considered.

²⁴ The NER requires that all classes of market benefits identified in relation to the RIT-T are included in the RIT-T assessment, unless the TNSP can demonstrate that a specific class (or classes) is unlikely to be material in relation to the RIT-T assessment for a specific option – NER clause 5.16.1(c)(6). See Appendix A for requirements applicable to this document.

²⁵ Australian Energy Regulator. “*Application guidelines Regulatory Investment Test for Transmission - August 2020.*” Melbourne: Australian Energy Regulator. <https://www.aer.gov.au/system/files/AER%20-%20Regulatory%20investment%20test%20of%20or%20transmission%20application%20guidelines%20-%2025%20August%202020.pdf>

<p>Option value</p>	<p>Transgrid notes the AER’s view that option value is likely to arise where there is uncertainty regarding future outcomes, the information that is available is likely to change in the future, and the credible options considered by the TNSP are sufficiently flexible to respond to that change.²⁶</p> <p>Transgrid also notes the AER’s view that appropriate identification of credible options and reasonable scenarios captures any option value, thereby meeting the NER requirement to consider option value as a class of market benefit under the RIT-T.</p> <p>Transgrid notes that no credible option is sufficiently flexible to respond to change or uncertainty.</p> <p>Additionally, a significant modelling assessment would be required to estimate the option value benefits but it would be disproportionate to potential additional benefits for this RIT-T. Therefore, Transgrid has not estimated additional option value benefit.</p>
---------------------	--

²⁶ Australian Energy Regulator. “*Application guidelines Regulatory Investment Test for Transmission - August 2020.*” Melbourne: Australian Energy Regulator. <https://www.aer.gov.au/system/files/AER%20-%20Regulatory%20investment%20test%20for%20transmission%20application%20guidelines%20-%2025%20August%202020.pdf>

5. Overview of the assessment approach

This section outlines the approach that Transgrid has applied in assessing the net benefits associated with each of the credible options against the base case.

5.1. Description of the base case

The costs and benefits of each option in this document are compared against the base case. Under this base case, no investment is undertaken, Transgrid incurs regular and reactive maintenance costs, and the line will continue to operate with an increasing level of risk.

Transgrid notes that this course of action is not expected in practice. However, this approach has been adopted since it is consistent with AER guidance on the base case for RIT-T applications.²⁷

5.2. Assessment period and discount rate

A 20 year post-commissioning assessment period from 2023/24 to 2042/43 was considered in this analysis. This period takes into account the size, complexity and expected asset life of the options.

Transgrid adopted a central real, pre-tax 'commercial' discount rate²⁸ of 5.90 per cent as the central assumption for the NPV analysis presented in this report. Transgrid considers that this is a reasonable contemporary approximation of a commercial discount rate and it is consistent with the commercial discount rate calculated in the RIT-T Economic Assessment Handbook (Version 2.0) published by Energy Networks Australia (ENA) in October 2020²⁹.

Transgrid also tested the sensitivity of the results to discount rate assumptions. A lower bound real, pre-tax discount rate of 2.23 per cent equal to the latest AER Final Decision for a TNSP's regulatory proposal at the time of preparing this document³⁰, and an upper bound discount rate of 9.57 per cent (a symmetrical adjustment upwards) were used.

5.3. Approach to estimating option costs

Transgrid has estimated the capital costs of the options based on the scope of works necessary together with costing experience from previous projects of a similar nature. Transgrid estimates that the actual cost is within +/- 25 per cent of the central capital cost.

²⁷ Transgrid notes that the AER RIT-T Guidelines state that the base case is where the RIT-T proponent does not implement a credible option to meet the identified need, but rather continues its 'BAU activities'. The AER define 'BAU activities' as ongoing, economically prudent activities that occur in the absence of a credible option being implemented. Australian Energy Regulator. "Application guidelines Regulatory Investment Test for Transmission - August 2020." Melbourne: Australian Energy Regulator. <https://www.aer.gov.au/system/files/AER%20-%20Regulatory%20investment%20test%20for%20transmission%20application%20guidelines%20-%2025%20August%202020.pdf>

²⁸ The use of a 'commercial' discount rate is consistent with the RIT-T and is distinct from the regulated cost of capital (or 'WACC') that applies to network businesses like Transgrid.

²⁹ Available at <https://www.energynetworks.com.au/resources/fact-sheets/ena-rit-t-handbook-2020/> Note the lower bound discount rate of 2.23 per cent is based on the most recent final decision for a TNSP revenue determination which was Directlink in June 2020.

³⁰ See 2020-25 Directlink's Post-tax Revenue Model (PTRM) cashflow derived pre-tax real WACC available at: <https://www.aer.gov.au/networks-pipelines/determinations-access-arrangements/directlink-determination-2020-25/final-decision>

Routine operating and maintenance costs are based on works of similar nature.

5.4. Three different scenarios have been modelled to address uncertainty

The assessment was conducted under three net economic benefits scenarios. These are plausible scenarios which reflect different assumptions about the future market development and other factors that are expected to affect the relative market benefits of the options being considered. All scenarios (low, central and high) involve a number of assumptions that result in the lower bound, the expected, and the upper bound estimates for present value of net economic benefits respectively.

A summary of the key variables in each scenario is provided in the table below.

Table 5-1 Summary of scenarios

Variable / Scenario	Central	Low benefit scenario	High benefit scenario
<i>Scenario weighting</i>	50%	25%	25%
Discount rate	5.90%	9.57%	2.23%
Costs			
Network capital costs	Base estimate	Base estimate + 25%	Base estimate - 25%
Operating and maintenance costs	Base estimate	Base estimate + 25%	Base estimate - 25%
Benefits (negative benefits)			
Reduction in safety and environmental risk costs	Base estimate	Base estimate - 25%	Base estimate + 25%

Transgrid considered that the central scenario was most likely since it was based primarily on a set of expected assumptions. Transgrid therefore assigned this scenario a weighting of 50 per cent, with the other two scenarios being weighted equally with 25 per cent each.

6. Assessment of credible options

This section outlines the assessment Transgrid has undertaken of the credible network options. The assessment compares the costs and benefits of each credible option to the base case. The benefits of each credible option are represented by reduction in costs or risks compared to the base case.

All costs presented in this PACR are in 2021/22 dollars.

6.1. Estimated gross benefits

The table below summarises the present value of the gross benefit estimates for each credible option relative to the base case under the three scenarios.

The benefits included in this assessment are:

- Reduction in safety and environmental risks.

Table 6-1 Estimated gross benefits from credible options relative to the base case, present value (\$m 2021/22)

Option/scenario	Central	Low benefit scenario	High benefit scenario	Weighted
<i>Scenario weighting</i>	50%	25%	25%	
Option 1	297.9	163.8	533.6	323.3

6.2. Estimated costs

The table below summarises the capital costs of the options, relative to the base case, in present value terms. The cost of each credible option has been calculated for each of the three reasonable scenarios outlined in section 5.4.

Table 6-2 Costs of credible options relative to the base case, present value (\$m 2021/22)

Option/Scenario	Central	Low benefit scenario	High benefit scenario	Weighted
<i>Scenario weighting</i>	50%	25%	25%	
Option 1	16.3	20.0	12.4	16.2

6.3. Estimated net economic benefits

These net economic benefits are the differences between the estimated gross benefits less the estimated costs. The table below summarises the present value of the net economic benefits for each credible option across the three scenarios and the weighted net economic benefits.

Option 1 is found to have positive net benefits for the central and high benefit scenarios investigated. On a weighted basis, Option 1 will deliver approximately \$302 million in net economic benefits above the base case.

Table 6-3 Net economic benefits for Option 1 relative to the base case, present value (\$m 2021/22)

Option	Central	Low benefit scenario	High benefit scenario	Weighted	Ranking
Scenario weighting	50%	25%	25%		
Option 1	281.7	143.8	521.2	307.1	1

Figure 6-1 Net economic benefits, present value (\$m 2021/22)



6.4. Sensitivity testing

Transgrid undertakes sensitivity testing to understand the robustness of the RIT-T assessment to underlying assumptions about key variables. In particular, Transgrid undertakes two sets of sensitivity tests – namely:

- Step 1 – testing the sensitivity of the optimal timing of the project ('trigger year') to different assumptions in relation to key variables
- Step 2 – once a trigger year has been determined, testing the sensitivity of the total NPV benefit associated with the investment proceeding in that year, in the event that actual circumstances turn out to be different.

Having assumed to have committed to the project by this date, Transgrid has also looked at the consequences of 'getting it wrong' under step 2 of the sensitivity testing. That is, if expected safety and environmental risks are not as high as expected, for example, the impact on the net economic benefit associated with the project continuing to go ahead on that date.

The application of the two steps to test the sensitivity of the key findings is outlined below.

6.4.1. Step 1 – Sensitivity testing of the optimal timing


Transgrid has estimated the optimal timing for Option 1 based on the year in which the NPV is maximised. This process was undertaken for both the central set of assumptions and also a range of alternative assumptions for key variables. This section outlines the sensitivity of the identification of the commissioning

year to changes in the underlying assumptions. In particular, the optimal timing of the option is found to be invariant to the assumptions of:

- a 25 per cent increase/decrease in the assumed network capital costs
- lower discount rate of 2.23 per cent as well as a higher rate of 9.57 per cent
- lower (or higher) assumed operation and maintenance costs
- lower (or higher) assumed safety and environmental risks

The figure below outlines the impact on the optimal commissioning year, under a range of alternative assumptions. It illustrates that for Option 1, the optimal commissioning date is found to be in 2022/23, such that the benefits are realised from 2023/24, for all of the sensitivities investigated.

Figure 6-2 Optimal timing of Option 1

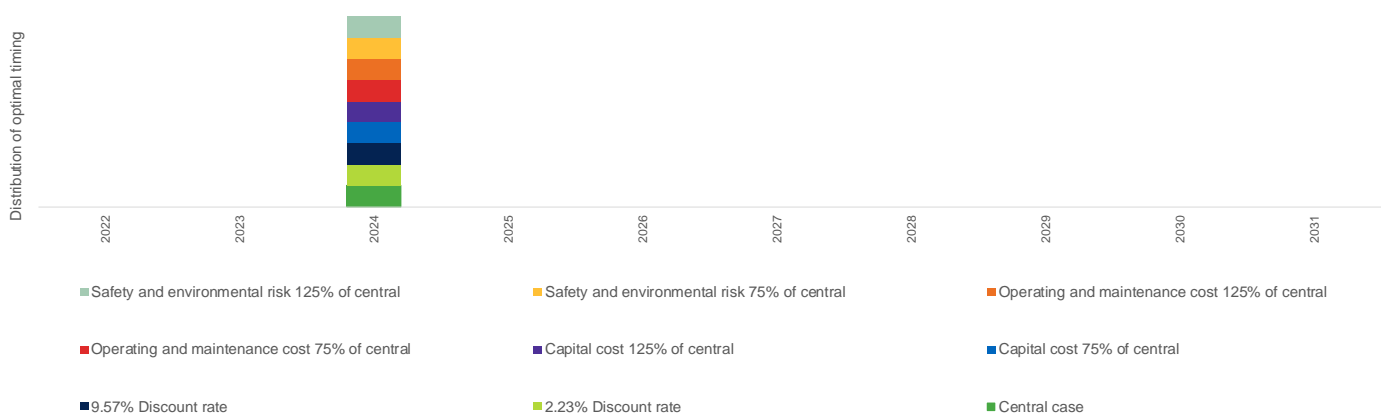

6.4.2. Step 2 – Sensitivity of the overall net benefit


Transgrid has conducted sensitivity analysis on the present value of the net economic benefit, based on having to undertake the project by 2022/23. Specifically, Transgrid has investigated the same sensitivities under this step as in the first step:

- a 25 per cent increase/decrease in the assumed network capital costs
- lower discount rate of 2.23 per cent as well as a higher rate of 9.57 per cent
- lower (or higher) assumed operation and maintenance costs
- lower (or higher) assumed safety and environmental risks

All these sensitivities investigate the consequences of ‘getting it wrong’ having committed to a certain investment decision.

The figures below illustrate the estimated net economic benefits for each option if separate key assumptions in the central scenario are varied individually. Option 1 delivers positive benefits under all scenarios. The figures below illustrate that while the results are most sensitive to the safety and environmental risk costs estimates and the discount rate, it is still reasonable to make investments to mitigate the risk.

Figure 6-3 Sensitivities

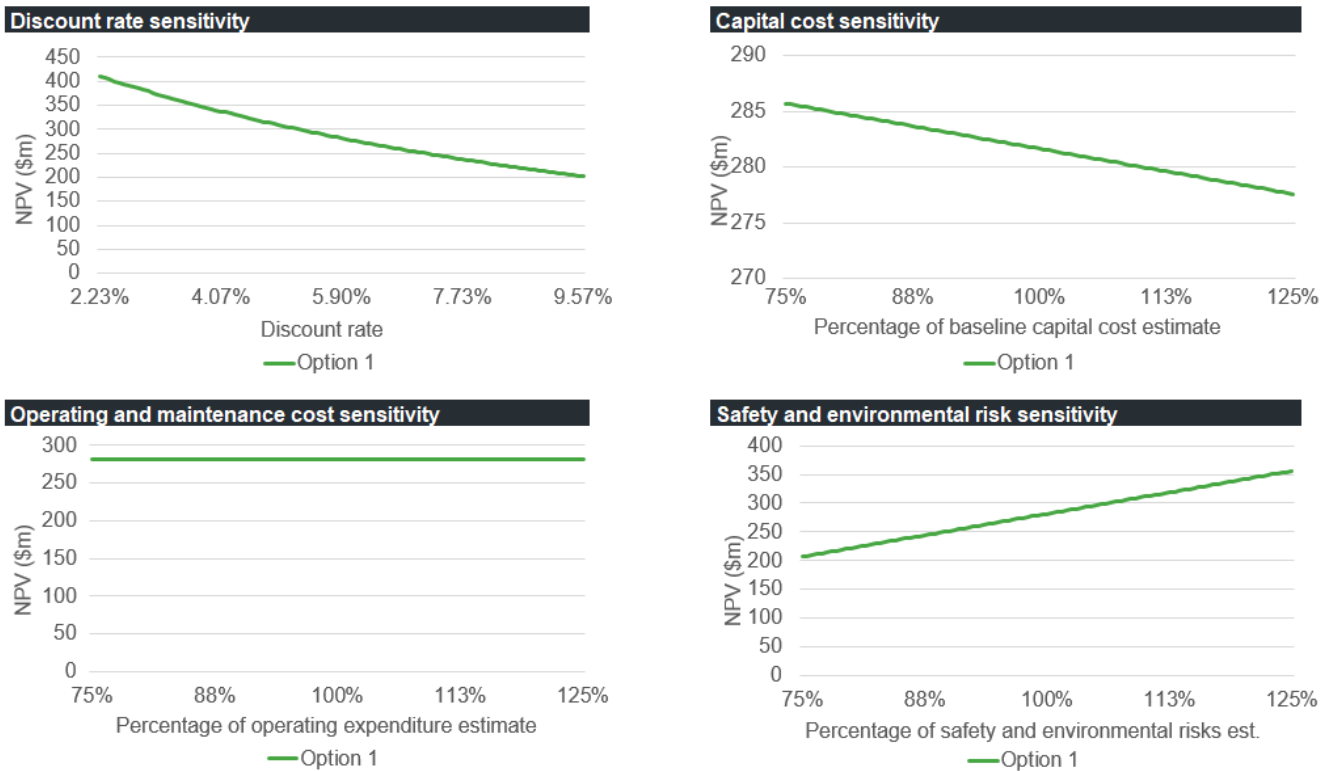

6.5. Meeting relevant regulatory obligations

Transgrid considers that the sensitivity assessment discussed in section 6.4 demonstrates that planning for any commissioning later than 2022/23 would be inconsistent with the ALARP obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014. In particular, due to higher risk cost associated with safety and environmental risk, there would be lower expected net market benefits (greater net market cost) if the replacement works were delayed.

Transgrid manages and mitigates bushfire and safety risk to ensure they are below risk tolerance levels or 'As Low As Reasonably Practicable' ('ALARP'), in accordance with Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS).³¹

Under the ALARP test a gross disproportionate factor³² would typically be applied. Applying the factor in this case would only further enhance support for Option 1 as the outcome of the weighted NPV analysis already demonstrates that the benefits are positive. Transgrid's analysis concluded that the costs are less than the

³¹ Transgrid's ENSMS follows the International Organization for Standardization's ISO31000 risk management framework which requires following hierarchy of hazard mitigation approach.

³² In accordance with the framework for applying the ALARP principle, a disproportionality factor of 6 is typically applied to risk cost figures. The values of the disproportionality factors applied by Transgrid were determined through a review of practises and legal interpretations across multiple industries, with particular reference to the works of the UK Health and Safety Executive. The methodology used to determine the disproportionality factors is in line with the principles and examples presented in the AER Replacement Planning Guidelines and is consistent with Transgrid's Revised Revenue Proposal 2018/19- 2022/23.

weighted benefits from mitigating bushfire and safety risks. Accordingly, Transgrid has not repeated the assessment with the disproportionality factor multipliers.

The proposed investment will enable Transgrid to continue to manage and operate this part of the network to a safety and risk mitigation level of ALARP. Consequently, it is considered a reliability corrective action under the RIT-T. A reliability corrective action differs from a 'market benefits'-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

7. Final conclusion on the preferred option

The optimal commercially and technically feasible option presented in this PACR – Option 1 (line refurbishment) – remains the preferred option to meet the identified need. Option 1 can be implemented in sufficient time to meet the identified need by 2022/23, and is therefore the preferred option presented in this PACR.

Moving forward with this option is the most prudent and economically efficient solution to manage and mitigate safety and environmental risk to ALARP. Consequently, it will ensure Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS) are met.

The estimated capital expenditure associated with this option is \$16.7 million +/- 25 per cent. Routine operating and maintenance costs relating to planned checks by Transgrid field crew are approximately \$41,000 per year – similar to the cost under the base case. Transgrid calculates that the avoided risk cost by undertaking Option 1 is approximately \$27.3 million per year. Further, a reduction in reactive corrective maintenance costs is also expected. This has not been included in the NPV analysis.

This preferred option, Option 1, is found to have positive net benefits under all scenarios investigated and on a weighted basis will deliver approximately \$307 million in net economic benefits. Transgrid also conducted sensitivity analysis on the net economic benefit to investigate the robustness of the conclusion to key assumptions. Transgrid finds that under all sensitivities, positive net benefits are expected from refurbishing Line 21.

The works will be undertaken between 2020/21 and 2022/23. Planning and procurement (including completion of the RIT-T) commenced in 2020/21 and is due to conclude in 2021/22, while project delivery and construction will occur in 2022/23.

All works will be completed in accordance with the relevant standards by 2022/23 with minimal modification to the wider transmission assets. Necessary outages of affected line(s) in service will be planned appropriately in order to complete the works with minimal impact on the network.

Option 1 is the preferred option in accordance with NER clause 5.16.1(b) because it is the credible option that maximises the net present value of the net economic benefit to all those who produce, consume and transport electricity in the market. The analysis undertaken and the identification of Option 1 as the preferred option satisfies the RIT-T.

Appendix A Compliance checklist

This appendix sets out a checklist which demonstrates the compliance of this PACR with the requirements of the National Electricity Rules version 174.

Rules clause	Summary of requirements	Relevant section
5.16.4(v)	The project assessment conclusions report must set out:	–
	(1) the matters detailed in the project assessment draft report as required under paragraph (k); and	See below.
	(2) a summary of, and the RIT-T proponent's response to, submissions received, if any, from <i>interested parties</i> sought under paragraph (q).	NA
5.16.4(k)	The project assessment draft report must include:	–
	(1) a description of each credible option assessed;	3
	(2) a summary of, and commentary on, the submissions to the project specification consultation report;	NA
	(3) a quantification of the costs, including a breakdown of operating and capital expenditure, and classes of material market benefit for each credible option;	3, 4
	(4) a detailed description of the methodologies used in quantifying each class of material market benefit and cost;	5
	(5) reasons why the RIT-T proponent has determined that a class or classes of market benefit are not material;	4
	(6) the identification of any class of market benefit estimated to arise outside the <i>region</i> of the <i>Transmission Network Service Provider</i> affected by the RIT-T project, and quantification of the value of such market benefits (in aggregate across all regions);	3, 4
	(7) the results of a net present value analysis of each credible option and accompanying explanatory statements regarding the results;	6
	(8) the identification of the proposed preferred option;	7
	(9) for the proposed preferred option identified under subparagraph (8), the RIT-T proponent must provide: <ul style="list-style-type: none"> (i) details of the technical characteristics; (ii) the estimated construction timetable and commissioning date; (iii) if the proposed preferred option is likely to have a <i>material inter-network impact</i> and if the <i>Transmission Network Service Provider</i> affected by the RIT-T project has received an augmentation technical report, that report; and (iv) a statement and the accompanying detailed analysis that the preferred option satisfies the <i>regulatory investment test for transmission</i>. 	3, 7

Appendix B Risk Assessment Methodology

This appendix summarises the key assumptions and data from the risk assessment methodology that underpin the identified need for this RIT-T and the assessment undertaken for the Revenue Proposal.³³

As part of preparing its Revenue Proposal for the current regulatory control period, Transgrid developed the Network Asset Risk Assessment Methodology to quantify risk for replacement and refurbishment projects. The risk assessment methodology:


- uses externally verifiable parameters to calculate asset health and failure consequences
- assesses and analyses asset condition to determine remaining life and probability of failure
- applies a worst-case asset failure consequence and significantly moderates this down to reflect the likely consequence in a particular circumstance
- identifies safety and compliance obligations with a linkage to key enterprise risks

B.1 Overview of the risk assessment methodology

A fundamental part of the risk assessment methodology is calculating the ‘risk costs’ or the monetised impacts of the reliability, safety, environmental and other risks.

The figure below summarises the framework for calculating the ‘risk costs’, which has been applied on Transgrid’s asset portfolio considered to need replacement or refurbishment.

Figure B-1 Overview of Transgrid’s ‘risk cost’ framework

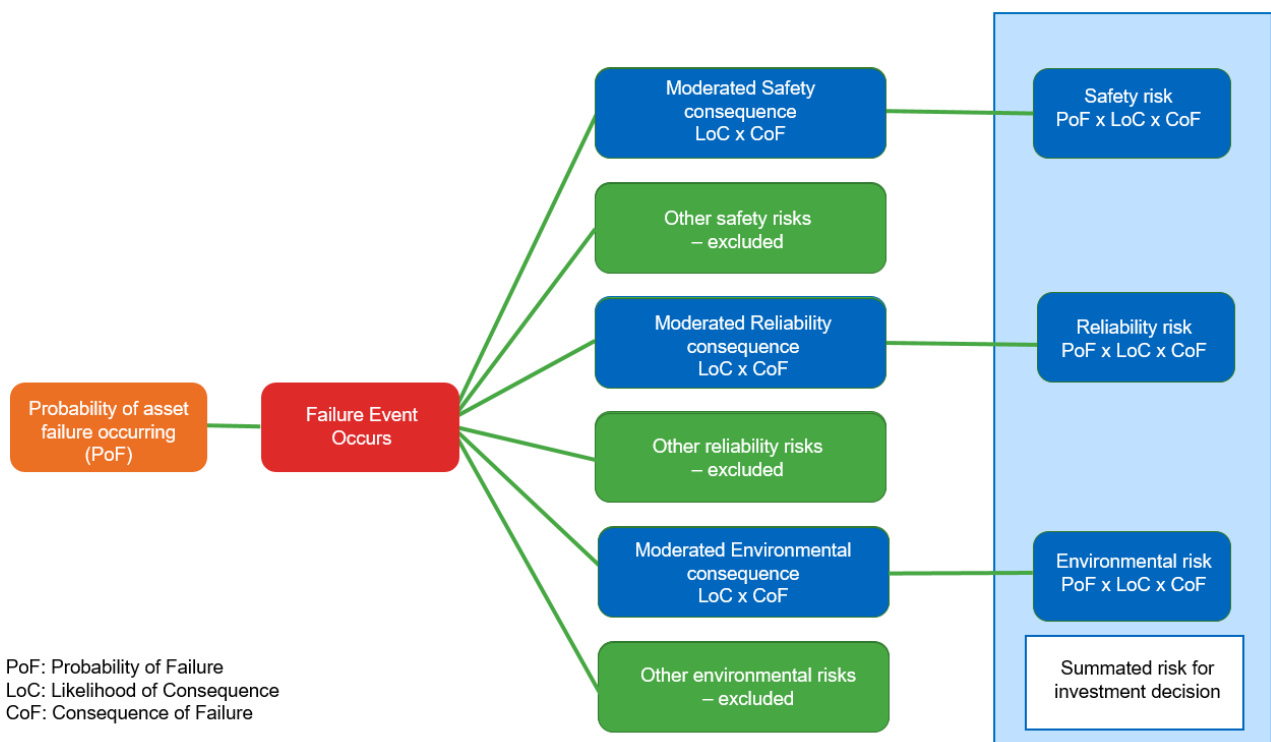

³³ Transgrid. “Revised Regulatory Proposal 2018/19-2022/23.” Melbourne: Australian Energy Regulator, 2017. 63-69. Accessed 15 March 2019. <https://www.aer.gov.au/system/files/TransGrid%20-%20Revised%20Revenue%20Proposal%20-%201%20December%202017.pdf>

The 'risk costs' are calculated based on the Probability of Failure (PoF), the Consequence of Failure (CoF), and the corresponding Likelihood of Consequence (LoC).

In calculating the PoF, each failure mode that could result in significant impact is considered. For replacement planning, only life-ending failures are used to calculate the risk costs. PoF is calculated for each failure mode based on 'conditional age' (health-adjusted chronological age), failure and defect history, and benchmarking studies. For 'wear out' failures, a Weibull curve may be fitted; while for random failures, a static failure rate may be used.

In calculating the CoF, LoC and risks, Transgrid uses a moderated 'worst case' consequence. This is an accepted approach in risk management and ensures that high impact, low probability (HILP) events are not discounted. The approach excludes the risk costs of low impact, high probability (LIHP) which would result in lower calculated risk.