



TransGrid

Maintaining compliance with performance standards applicable to Deniliquin substation secondary systems

RIT-T Project Assessment Conclusions Report

Region: Southern

Date of issue: 4 May 2020

Disclaimer

This suite of documents comprises TransGrid's application of the Regulatory Investment Test for Transmission (RIT-T) which has been prepared and made available solely for information purposes. It is made available on the understanding that TransGrid and/or its employees, agents and consultants are not engaged in rendering professional advice. Nothing in these documents is a recommendation in respect of any possible investment.

The information in these documents reflect the forecasts, proposals and opinions adopted by TransGrid at the time of publication, other than where otherwise specifically stated. Those forecasts, proposals and opinions may change at any time without warning. Anyone considering information provided in these documents, at any date, should independently seek the latest forecasts, proposals and opinions.

These documents include information obtained from the Australian Energy Market Operator (AEMO) and other sources. That information has been adopted in good faith, without further enquiry or verification. The information in these documents should be read in the context of the Electricity Statement of Opportunities, the National Transmission Network Development Plan published by AEMO and other relevant regulatory consultation documents. It does not purport to contain all of the information that AEMO, a prospective investor, Registered Participant or potential participant in the National Electricity Market (NEM), or any other person may require for making decisions. In preparing these documents it is not possible, nor is it intended, for TransGrid to have regard to the investment objectives, financial situation and particular needs of each person or organisation which reads or uses this document. In all cases, anyone proposing to rely on or use the information in this document should:

1. Independently verify and check the currency, accuracy, completeness, reliability and suitability of that information
2. Independently verify and check the currency, accuracy, completeness, reliability and suitability of reports relied on by TransGrid in preparing this document
3. Obtain independent and specific advice from appropriate experts or other sources.

Accordingly, TransGrid makes no representations or warranty as to the currency, accuracy, reliability, completeness or suitability for particular purposes of the information in this suite of documents.

Persons reading or utilising this suite of RIT-T related documents acknowledge and accept that TransGrid and/or its employees, agents and consultants have no liability for any direct, indirect, special, incidental or consequential damage (including liability to any person by reason of negligence or negligent misstatement) for any damage resulting from, arising out of or in connection with, reliance upon statements, opinions, information or matter (expressed or implied) arising out of, contained in or derived from, or for any omissions from the information in this document, except insofar as liability under any New South Wales and Commonwealth statute cannot be excluded.

Privacy notice

TransGrid is bound by the *Privacy Act 1988 (Cth)*. In making submissions in response to this consultation process, TransGrid will collect and hold your personal information such as your name, email address, employer and phone number for the purpose of receiving and following up on your submissions.

Under the National Electricity Law, there are circumstances where TransGrid may be compelled to provide information to the Australian Energy Regulator (AER). TransGrid will advise you should this occur.

TransGrid's Privacy Policy sets out the approach to managing your personal information. In particular, it explains how you may seek to access or correct the personal information held about you, how to make a complaint about a breach of our obligations under the Privacy Act, and how TransGrid will deal with complaints. You can access the Privacy Policy here (<https://www.transgrid.com.au/Pages/Privacy.aspx>).

Executive summary

TransGrid is applying the Regulatory Investment Test for Transmission (RIT-T) to options for maintaining reliable secondary systems at Deniliquin substation. Publication of this Project Assessment Conclusions Report (PACR) represents the final step in the RIT-T process.

Deniliquin substation will continue to play a central role in supporting the flow of energy to the Riverina region of New South Wales. It forms part of the wider South Western NSW network which supports renewable energy zone development.

TransGrid has identified the secondary systems at Deniliquin substation have reached a condition that reflects the end of serviceable life. As it is superseded by new technology at the manufacturer level and the existing technology becomes obsolete, spare parts become scarce and the ability of any primary asset connected to the substation to reliably operate will be at risk.

Identified need: meet the service level required under the National Electricity Rules for protection schemes

Secondary systems are used to control, monitor, protect and secure communication to facilitate safe and reliable network operation.¹ They are necessary to operate the transmission network and prevent damage to primary assets when adverse events occur.

Provision of redundant protection schemes to ensure the transmission system is adequately protected is a Network Performance Requirement under Schedule 5.1 of the National Electricity Rules (NER), therefore the condition issues affecting the secondary systems at Deniliquin substation must be addressed.

The Network Performance Requirements, set out in Schedule 5.1 of the NER, place an obligation on Transmission Network Service Providers (TNSPs) to provide redundant protection schemes to ensure the transmission system is adequately protected. Schedule 5.1.9(c) of the NER requires a TNSP to provide sufficient primary and back-up protection systems, including any communications facilities and breaker fail protection systems, to ensure that a fault of any type anywhere on its transmission system is automatically disconnected.

Additionally, TNSPs are required to disconnect the unprotected primary systems where secondary systems fault lasts for more than eight hours (for planned maintenance) or 24 hours (for unplanned outages). TNSPs must also ensure that all protection systems for lines at a voltage above 66 kV are well-maintained so as to be available at all times other than for short periods of less than eight hours for maintenance of the protection systems.² In the event of an unplanned outage, AEMO's Power System Security Guidelines require that the primary network assets must be taken out of service within 24 hours.³

Furthermore, as per clause 4.11.1 of the NER, remote monitoring and control systems are required to be maintained in accordance with the standards and protocols determined and advised by AEMO.

A failure of the secondary systems will involve replacement of the failed component or taking the affected primary assets, such as lines and transformers, out of service.

Though replacement of failed secondary systems component is a possible interim measure, the approach is not sustainable as the stock of spare components will deplete due to the technology no longer being

¹ As per Schedule 5.1 of the NER.

² As per S5.1.2.1(d) of the NER.

³ Australian Energy Market Operator. "Power System Security Guidelines, 23 April 2019." Melbourne: Australian Energy Market Operator, 2019. Accessed 15 May 2019. https://www.aemo.com.au/-/media/Files/Electricity/NEM/Security_and_Reliability/Power_System_Ops/Procedures/SO_OP_3715---Power-System-Security-Guidelines.pdf

manufactured or supported. Once all spares are used, replacement will cease to be a viable option to meet performance standards stipulated in clause 4.6.1. of the NER.

If the failure to provide functional secondary systems due to technology obsolescence is not addressed by a technically and commercially feasible credible option in sufficient time (by 2022/23), the likelihood of not recovering from secondary systems faults and not maintaining compliance with NER performance requirements will increase.

The proposed investment will enable TransGrid to continue to meet the standards for secondary systems availability set out in the NER, and to avoid the impacts of taking primary assets out of service. Consequently, it is considered a reliability corrective action under the RIT-T.

A reliability corrective action differs from a 'market benefits'-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

No submissions received in response to Project Specification Consultation Report

TransGrid published a Project Specification Consultation Report (PSCR) on 27 May 2019 and invited written submissions on the material presented within the document. No submissions were received in response to the PSCR.

No material developments since publication of the PSCR

No additional credible options were identified during the consultation period following publication of the PSCR.

The following changes have occurred since the PSCR which have not made an impact on the preferred option:

- > updated the discount rates used
- > inflation escalation update
- > removed unserved energy from the NPV analysis
- > identified potential structural issues with the existing building at Deniliquin substation

Option 1 remains the preferred option at this stage of the RIT-T process.

Secondary Systems Buildings replacement remains the most prudent and economically efficient option to meet regulatory obligations

In the PSCR TransGrid put forward for consideration three technically and commercially feasible options:

- > **Option 1** – a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular secondary system building (SSB) and installing new cables throughout
- > **Option 2** – complete in-situ replacement of all secondary systems assets at Deniliquin substation whilst retaining existing building and cables
- > **Option 3** – strategic asset replacement involving individual replacement of identified assets up to 2023 whilst retaining existing building and cables

Option 1 remains the most prudent and economically efficient option to address the identified need. Implementation of Option 1 will enable TransGrid to continue meeting its regulatory obligations set out in clauses 4.11.1, 4.6.1(b),⁴ and Schedule 5.1 of the NER. Consequently, it will ensure the performance standards

⁴ As per clause 4.6.1(b) of the NER, AEMO must ensure that there are processes in place, which will allow the determination of fault levels for normal operation of the power system and in anticipation of all credible contingency events and protected events that AEMO considers may affect the configuration of the power system, so that AEMO can identify any busbar which could potentially be exposed to a fault level which exceeds the fault current ratings of the circuit breakers associated with that busbar.

applicable to Deniliquin substation secondary systems are met and is therefore the preferred option for this RIT-T.

The options are summarised in the table below.

TransGrid expects coronavirus (COVID-19) to impact its suppliers and disrupt their supply chains. TransGrid has preliminary advice that this is already occurring, although at this time the extent of the current or future impact is unknown. Consequently, some of the costs associated with the works outlined in this document may be affected.

All costs presented in this PACR are in 2019/20 dollars.

Table E-1 Options considered

Option	Description	Capital costs (\$m 2019/20)	Operating costs (\$ 2019/20 per year)	Remarks
Option 1	Secondary Systems Buildings replacement (SSB)	11.0 (+/- 25%)	~4,000	Most economically beneficial and preferred option
Option 2	Complete in-situ (on-site) replacement	4.7 (+/- 25%)	~4,000	Less efficient and does not address existing cables and building foundation issues
Option 3	Strategic asset replacement	3.1 (+/-25%) by 2022/23 and 0.6 (+/- 25%) in 2024/25	~4,000	Less efficient and does not address existing cables and building foundation issues

Non-network options are not able to assist in this RIT-T

In the PSCR, TransGrid noted that non-network options are not considered to be commercially and technically feasible to assist with meeting the identified need for this RIT-T. This is because non-network options will not enable TransGrid to continue meeting its NER obligation to provide redundant secondary systems and ensure that the transmission system is adequately protected.

Option 1 delivers the most benefit to consumers

In this PACR TransGrid has considered three credible options which have been assessed relative to the base case. Of the credible options considered, Option 1 delivers the most benefit to consumers.

In the sensitivity analysis, under some conditions Option 2 becomes the preferred option. The most relevant scenario is increased capital cost. However, TransGrid still considers Option 1 to be superior based on:

- > Option 1 provides a larger overall safety risk reduction benefit over Options 2 and 3. This is because Options 2 and 3 cannot address the risks posed by the existing substandard cabling as it is not feasible to replace the cables in-situ due to space constraints. The capital cost difference between Option 1 and Options 2 and 3 is driven by cabling costs.
- > Subsequent to the publication of the PSCR, potentially significant structural issues with the existing building at Deniliquin substation were identified. The cost of building remediation works is currently not included in Options 2 and 3 as costly and time consuming invasive inspection is required to determine the extent of works. This is a conservative approach as it underestimates the capital cost for Options 2 and 3. Inclusion of the building remediation cost to the current cost estimate for Options 2 and 3 will only strengthen the position of Option 1 as the preferred option.

Conclusion: a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular Secondary Systems Buildings is optimal

The optimal commercially and technically feasible option presented in the PSCR – Option 1 (a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular SSB and installing new cable throughout) – remains the preferred option to meet the identified need. Option 1 can be implemented in sufficient time to meet the identified need by 2022/23, and is therefore the preferred option presented in this PACR.

Moving forward with this option is the most prudent and economically efficient solution to enable TransGrid to continue meeting its regulatory obligations set out in clauses 4.11.1, 4.6.1(b),⁵ and Schedule 5.1 of the NER. Consequently, it will ensure the performance standards applicable to Deniliquin substation secondary systems are met.

Option 1 involves a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular SSB and installing new cable throughout.

The estimated capital cost of this option is approximately \$11.0 million. Routine and operating maintenance costs are approximately \$4,000 per year.

The works will be undertaken between 2019/20 and 2022/23. Planning and procurement (including completion of the RIT-T) will occur between 2018/19 and 2019/20, while the procurement and delivery of the identified assets is planned to occur prior to 2020/21 and all works will be completed by 2022/23.

Necessary outages of relevant assets in service will be planned appropriately in order to complete the works with minimal impact on the network.

The analysis undertaken and the identification of Option 1 as the preferred option satisfies the RIT-T.

⁵ As per clause 4.6.1(b) of the NER, AEMO must ensure that there are processes in place, which will allow the determination of fault levels for normal operation of the power system and in anticipation of all credible contingency events and protected events that AEMO considers may affect the configuration of the power system, so that AEMO can identify any busbar which could potentially be exposed to a fault level which exceeds the fault current ratings of the circuit breakers associated with that busbar.

Next steps

This PACR represents the third step in a formal Regulatory Investment Test for Transmission (RIT-T) process undertaken by TransGrid. It follows a Project Specification Consultation Report (PSCR) released in May 2019. The second step, production of a Project Assessment Draft Report (PADR), was not required as the investment in relation to the preferred option is exempt from this part of the RIT-T process under NER clause 5.16.4(z1). Production of a PADR is not required⁶ due to:

- > the estimated capital cost of the proposed preferred option being less than \$43 million;
- > the PSCR states:
 - proposed preferred option (including reasons for the proposed preferred option)
 - RIT-T is exempt from producing a PADR
 - The proposed preferred option and any other credible option will not have material market benefits⁷ except for voluntary load curtailment and involuntary load shedding
- > RIT-T proponent considers that there were no PSCR submissions identifying additional credible options that could deliver a material market benefit; and
- > PACR must address any issues raised in relation to the proposed preferred option during the PSCR consultation.

As noted in the PSCR, the investments are intended to continue meeting Rules obligations and will not have material market benefit, therefore TransGrid is exempt from producing a PADR for this RIT-T.

Parties wishing to raise a dispute notice with the AER may do so prior to 2 June 2020 (30 days after publication of this PACR). Any dispute notices raised during this period will be addressed by the AER within 40 to 120 days, after which the formal RIT-T process will conclude.

Further details on the RIT-T can be obtained from TransGrid's Regulation team via RIT-TConsultations@transgrid.com.au. In the subject field, please reference 'Deniliquin Secondary Systems PACR'.

⁶ In accordance with NER clause 5.16.4(z1)(4), the exemption from producing a PADR will no longer apply if TransGrid considers that an additional credible option that could deliver a material market benefit is identified during the consultation period. No additional credible options were identified.

⁷ As per clause 5.16.1(c)(6)

Contents

1. Introduction	10
1.1 Purpose of this report	10
1.2 Next steps	10
2. The identified need	12
2.1 Background to the identified need	12
2.2 Description of the identified need	13
2.3 Assumptions underpinning the identified need	14
3. Potential credible options	16
3.1 Base case	16
3.2 Option 1 – Secondary Systems Buildings replacement	17
3.3 Option 2 – Complete in-situ (on-site) replacement of protection and control systems	18
3.4 Option 3 – Strategic asset replacement	19
3.5 No material inter-network impact is expected	20
3.6 Non-network options	21
3.7 Options considered but not progressed	21
4. Materiality of market benefits	22
4.1 Wholesale electricity market benefits are not material	22
4.2 No other classes of market benefits are material	22
5. Overview of the assessment approach	24
5.1 Description of the base case	24
5.2 Assessment period and discount rate	24
5.3 Approach to estimate option costs	24
5.4 Three different scenarios have been modelled to address uncertainty	25
6. Assessment of credible options	26
6.1 Estimated gross benefits	26
6.2 Estimated costs	27
6.3 Estimated net economic benefits	27
6.4 Meeting relevant regulatory obligations	28
6.5 Sensitivity testing	29
7. Final conclusion on the preferred option	32
Appendix A – Compliance checklist	33
Appendix B – Assumptions underpinning the identified need	34

List of Tables

Table 2-1 Identified condition of Deniliquin substation secondary systems	15
Table 3-1 Operating expenditure breakdown under the base case (\$ 2019/20)	16
Table 3-2 Capital expenditure breakdown under Option 1 (\$m 2019/20)	17
Table 3-3 Operating expenditure breakdown under Option 1 (\$ 2019/20)	18
Table 3-4 Capital expenditure breakdown under Option 2 (\$m 2019/20)	19
Table 3-5 Operating expenditure breakdown under Option 2 (\$ 2019/20)	19
Table 3-6 Capital expenditure breakdown under Option 3 (\$m 2019/20)	20
Table 3-7 Operating expenditure breakdown under Option 3 (\$ 2019/20)	20
Table 4-1 Reasons non-wholesale electricity market benefits are considered immaterial	22
Table 5-1 Summary of scenarios	25
Table 6-1 Estimated gross benefits from credible options relative to the base case, present value (\$m 2019/20)	26
Table 6-2 Estimated costs of credible options relative to the base case, present value (\$m 2019/20)	27
Table 6-3 Estimated net economic benefits relative to the base case, present value (\$m 2019/20)	27

List of Figures

Figure 1-1 This PACR is the third stage of the RIT-T process	11
Figure 2-1 Location of Deniliquin substation on TransGrid's South Western NSW transmission network	12
Figure 6-1 Net economic benefits, present value (\$m 2019/20)	28
Figure 6-2 Optimal timing of Option 1	29
Figure 6-3 Sensitivities	31
Figure B-1 Overview of TransGrid's 'risk cost' framework	34

1. Introduction

TransGrid is applying the Regulatory Investment Test for Transmission (RIT-T) to options for maintaining reliable secondary systems at Deniliquin substation.

TransGrid has commenced this RIT-T to examine and consult on options to address the need – mitigate and alleviate the deterioration of the secondary systems at Deniliquin substation and the risk from technology obsolescence. As investment is intended to maintain compliance with NER requirement, TransGrid considers this a reliability corrective action RIT-T.

1.1 Purpose of this report

The purpose of this PACR⁸ is to:

- > Describe the identified need
- > Describe and assess credible options to meet the identified need
- > Describe the option assessment approach used
- > Provide details of the proposed preferred option to meet the identified need.

1.2 Next steps

This PACR represents the third and final step of the consultation process in relation to the application of the Regulatory Investment Test for Transmission (RIT-T) process undertaken by TransGrid. It follows a Project Specification Consultation Report (PSCR) released in May 2019. No submissions were received in response to the PSCR.

The second step, production of a Project Assessment Draft Report (PADR), was not required as the investment in relation to the preferred option is exempt from this part of the RIT-T process under NER clause 5.16.4(z1).

Production of a PADR is not required⁹ due to:

- > the estimated capital cost of the proposed preferred option being less than \$43 million;
- > the PSCR states:
 - proposed preferred option (including reasons for the proposed preferred option)
 - RIT-T exemption from producing a PADR
 - The proposed preferred option and any other credible option will not have material market benefits¹⁰ except for voluntary load curtailment and involuntary load shedding
- > RIT-T proponent considers that there were no PSCR submissions identifying additional credible options that could deliver a material market benefit; and
- > PACR must address any issues raised in relation to the proposed preferred option during the PSCR consultation.


As noted in the PSCR, the investments are intended to continue meeting Rules obligations and will not have material market benefit, therefore TransGrid is exempt from producing a PADR for this RIT-T.

⁸ See Appendix A for the National Electricity Rules requirements.

⁹ In accordance with NER clause 5.16.4(z1)(4), the exemption from producing a PADR will no longer apply if TransGrid considers that an additional credible option that could deliver a material market benefit is identified during the consultation period. No additional credible options were identified.

¹⁰ As per clause 5.16.1(c)(6)

Figure 1-1 This PACR is the third stage of the RIT-T process¹¹

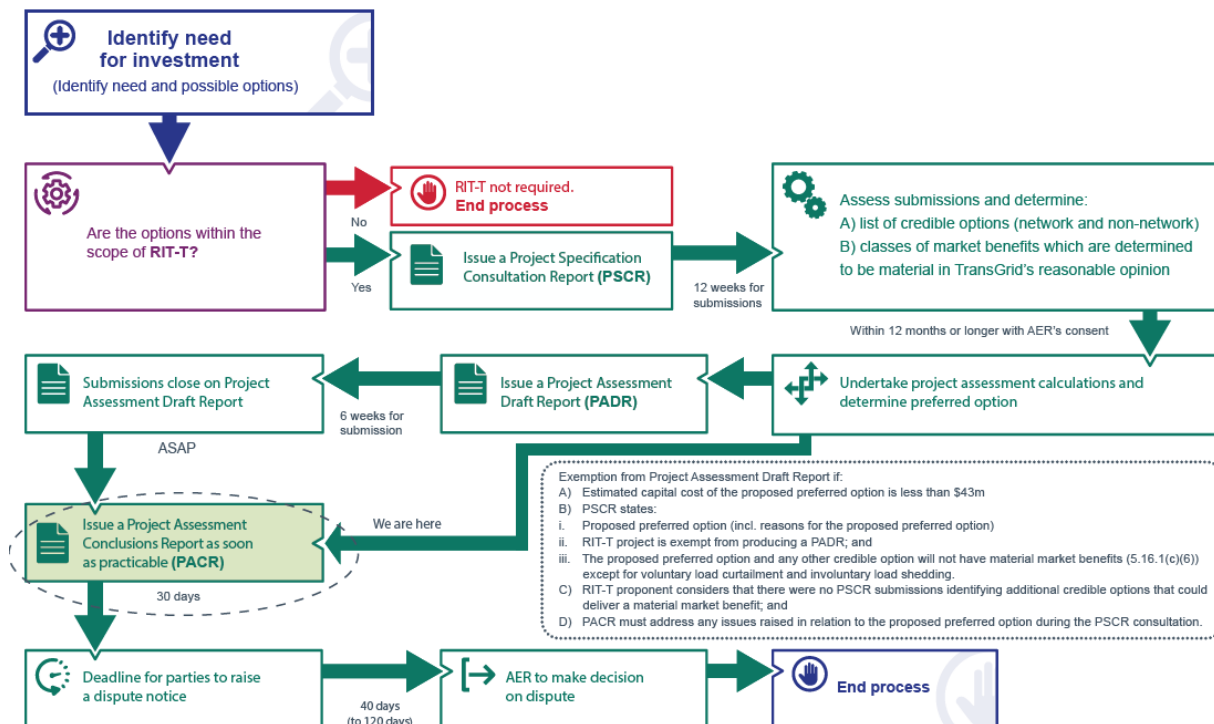

Parties wishing to raise a dispute notice with the AER may do so prior to 2 June 2020 (30 days after publication of this PACR). Any dispute notices raised during this period will be addressed by the AER within 40 to 120 days, after which the formal RIT-T process will conclude.

Further details on the RIT-T can be obtained from TransGrid's Regulation team via RIT-TConsultations@transgrid.com.au. In the subject field, please reference 'Deniliquin Secondary Systems PACR'.

¹¹ Australian Energy Market Commission. "Replacement expenditure planning arrangements, Rule determination". Sydney: AEMC, 18 July 2017.65. Accessed 19 November 2019. <https://www.aemc.gov.au/sites/default/files/content/89fbf559-2275-4672-b6ef-c2574eb7ce05/Final-rule-determination.pdf>

2. The identified need


This section outlines the identified need for this RIT-T, as well as the assumptions and data underpinning it. It first sets out background information related to the South Western NSW network and existing electricity supply arrangements.

2.1 Background to the identified need

Deniliquin substation will continue to play a central role in supporting the flow of energy to the Riverina region of southern NSW. It forms part of the wider South Western NSW network which supports renewable energy zone development¹².

The figure below depicts the location of Deniliquin substation on TransGrid's network.

Figure 2-1 Location of Deniliquin substation on TransGrid's South Western NSW transmission network

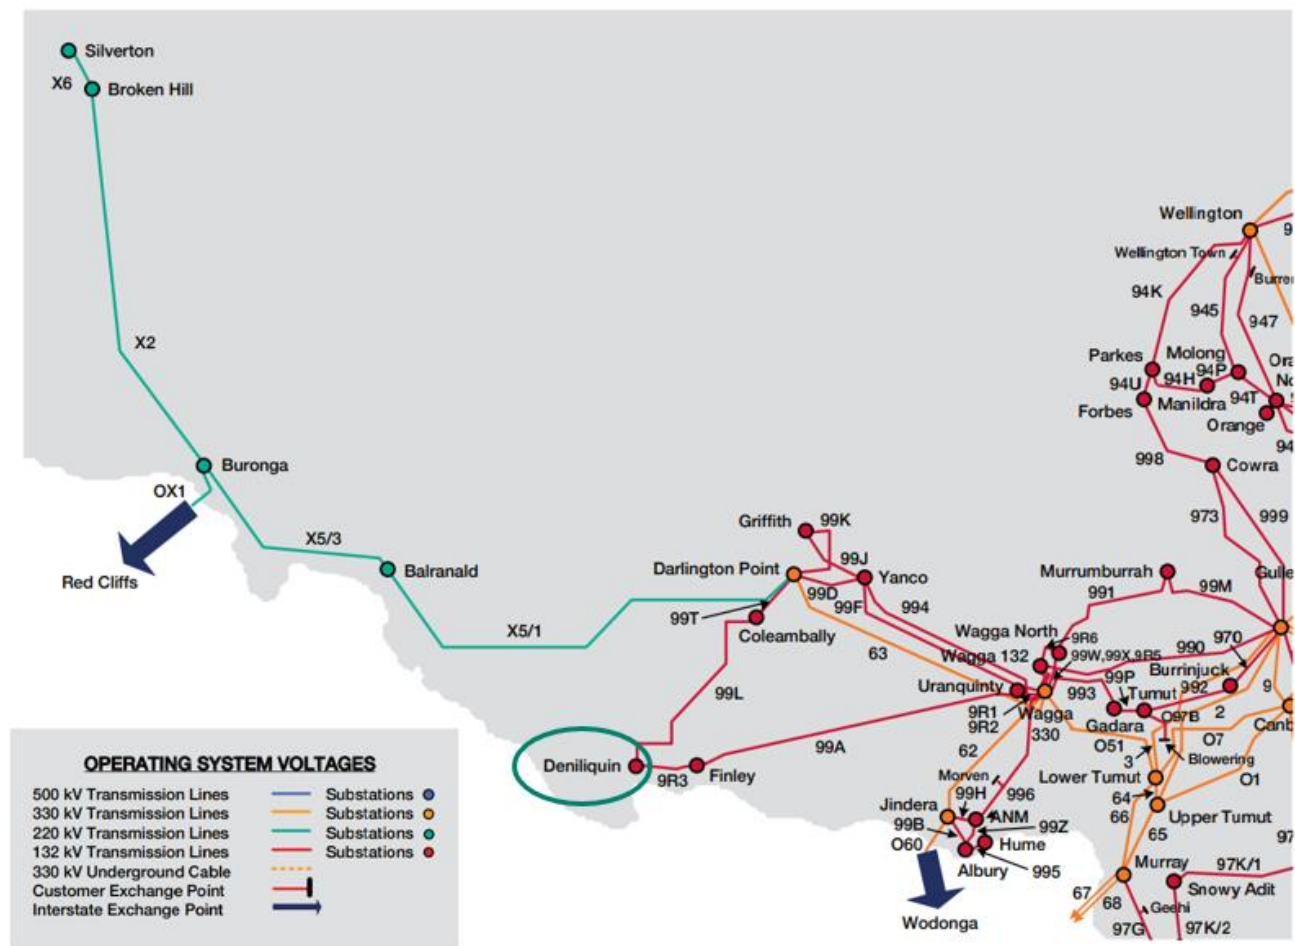

¹² There is over 5GW of potential wind and solar generation connections in South Western NSW and the Barrier Ranges. TransGrid, "Transmission Annual Planning Report 2019." Sydney: TransGrid, 2019. 45. Accessed 18 November, 2019. <https://www.transgrid.com.au/what-we-do/Business-Planning/transmission-annual-planning/Documents/2019%20Transmission%20Annual%20Planning%20Report.pdf>

Deniliquin 132/66 kV substation was commissioned in early 1970s and forms part of TransGrid's network that serves the Riverina region in South Western NSW. As a customer connection point supplying Essential Energy in the Deniliquin area, it supports the flow of electricity to nearby agricultural industries which mainly consist of irrigation and rice farming¹³, as well as a residential population of more than 7,000¹⁴. The load for Deniliquin substation is predominantly agricultural and residential¹⁵ which was approximately 54 MW in the summer of 2018/19¹⁶.

Deniliquin substation is supplied by Wagga 330 kV substation and Darlington Point substation, via two 132 kV transmission lines which connect at Coleambally (Line 99L) and Finley (Line 9R3). A further five feeders at 66 kV, all owned by Essential Energy, run between Deniliquin substation and Essential Energy substations in the surrounding area. In addition to these feeders, Deniliquin substation comprises two 132/66/11 kV transformers and three 66 kV capacitors. The secondary systems components at Deniliquin were installed between 1970 and 2007 to further support the safe and reliable operation of the substation.

This arrangement is necessary to ensure that all electricity users in South Western NSW, whether they are large industrial customers connected directly to TransGrid's network or residential consumers connected via Essential Energy's distribution network, are able to receive the level of support they require.

2.2 Description of the identified need

Secondary systems are used to control, monitor, protect and secure communication to facilitate safe and reliable network operation.¹⁷ They are necessary to operate the transmission network and prevent damage to primary assets when adverse events occur.

The Network Performance Requirements, set out in Schedule 5.1 of the NER, place an obligation on TNSPs to provide redundant protection schemes to ensure the transmission system is adequately protected. Schedule 5.1.9(c) of the NER requires a TNSP to provide sufficient primary and back-up protection systems, including any communications facilities and breaker fail protection systems, to ensure that a fault of any type anywhere on its transmission system is automatically disconnected.

Additionally, TNSPs are required to disconnect the unprotected primary systems where secondary systems fault lasts for more than eight hours (for planned maintenance) or 24 hours (for unplanned outages). TNSPs must also ensure that all protection systems for lines at a voltage above 66 kV are well-maintained so as to be available at all times other than for short periods of less than eight hours for maintenance of the protection systems.¹⁸ In the event of an unplanned outage, AEMO's Power System Security Guidelines require that the primary network assets must be taken out of service within 24 hours.¹⁹

Furthermore, as per clause 4.11.1 of the NER, remote monitoring and control systems are required to be maintained in accordance with the standards and protocols determined and advised by AEMO.

A failure of the secondary systems will involve replacement of the failed component or taking the affected primary assets, such as lines and transformers, out of service.

¹³ It is estimated that every \$1 of rice production equates to \$4 in flow on economic activity. Deniliquin is capable of producing significant tonnage of rice and is home to the largest rice mill in the southern hemisphere. Rice Growers' Association of Australia, "Rice Community", accessed 4 April, 2019. <http://www.rga.org.au/the-rice-industry/rice-community.aspx>

¹⁴ Australian Bureau of Statistics, "2016 Census QuickStats", accessed 4 April, 2019. https://quickstats.censusdata.abs.gov.au/census_services/getproduct/census/2016/quickstat/SSC11237

¹⁵ Australian Energy Market Operator, "AEMO Visualisations Map," accessed 3 April, 2019. <http://www.aemo.com.au/aemo/apps/visualisations/map.html>

¹⁶ TransGrid's Metering Data

¹⁷ As per Schedule 5.1 of the NER.

¹⁸ As per S5.1.2.1(d) of the NER.

¹⁹ Australian Energy Market Operator. "Power System Security Guidelines, 23 April 2019." Melbourne: Australian Energy Market Operator, 2019. Accessed 15 May 2019. https://www.aemo.com.au/-/media/Files/Electricity/NEM/Security_and_Reliability/Power_System_Ops/Procedures/SO_OP_3715---Power-System-Security-Guidelines.pdf

Though replacement of failed secondary systems component is a possible interim measure, the approach is not sustainable as the stock of spare components will deplete due to the technology no longer being manufactured or supported. Continued deterioration of the secondary systems at Deniliquin substation will accelerate the depletion of spares which will lead to a situation where TransGrid is unable to operate the secondary systems in accordance with clause 4.6.1 of the NER. Once all spares are used, replacement will cease to be a viable option to meet performance standards applicable to Deniliquin substation secondary systems.

If the failure to provide functional secondary systems due to technology obsolescence is not addressed by a technically and commercially feasible credible option in sufficient time (by 2022/23), the likelihood of not recovering from secondary systems faults and not maintaining compliance with NER performance requirements will increase.

The proposed investment will enable TransGrid to continue to meet the standards for secondary systems availability set out in the NER, and to avoid the impacts of taking primary assets out of service. Consequently, it is considered a reliability corrective action under the RIT-T.

A reliability corrective action differs from a 'market benefits'-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

2.3 Assumptions underpinning the identified need

2.3.1 Depletion of available spares due to withdrawal of manufacturer support for technologically obsolete components

Though like-for-like replacement of a failed secondary systems at Deniliquin substation is possible as an interim measure, the approach is not sustainable as the stock of spare components will deplete due to the technology no longer being manufactured or supported. Once all spares are used, repair will cease to be a viable option and will not enable performance standards applicable to Deniliquin substation secondary systems to be met.

2.3.2 Deterioration of control systems increases the risk of substation failure

Appendix B provides an overview of the Risk Assessment Methodology adopted by TransGrid. TransGrid has identified several critical issues with the secondary systems at Deniliquin substation. The issues outlined in **Error! Reference source not found.** are expected to escalate until the asset is fully inoperable.

Table 2-1 Identified condition of Deniliquin substation secondary systems

Asset components	Issues	% of services at site
Line/Feeder Protection Relays	<ul style="list-style-type: none"> > Component technology obsolescence resulting in a lack of spares and no manufacturer support > Inaccurate measurement of fault angles due to deteriorated internal components > End of asset life 	100% of all line/feeder protection relays on site
Transformer Protection Relays	<ul style="list-style-type: none"> > Component technology obsolescence resulting in a lack of spares and no manufacturer support > Faulty harmonic bias circuitry due to component failure > Internal wiring connection problems 	100% of all transformer protection relays on site
Busbar Protection Relays	<ul style="list-style-type: none"> > Degradation of plastic components causing mechanical failure of the pickup adjusting mechanism > Component technology obsolescence resulting in a lack of spares and no manufacturer support 	100% of all busbar protection relays on site
Capacitor Protection Relays	<ul style="list-style-type: none"> > Prone to excessive mechanical wear under certain situations, potentially causing a slow reset > Component technology obsolescence resulting in a lack of spares and no manufacturer support 	100% of all capacitor protection relays on site
NEM Market Meters	<ul style="list-style-type: none"> > Microprocessor Energy Meters failing as they approach 15 years of life > Component technology obsolescence resulting in a lack of spares and no manufacturer support 	100% of all market meters on site

3. Potential credible options

This section describes the options explored by TransGrid to address the need, including the scope of each option and the associated costs. Refer to section 6.1 for benefits of each option.

TransGrid considered three technically and commercially feasible options in the PSCR and this PACR:

- > **Option 1** – a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular SSB and installing new cables throughout;
- > **Option 2** – complete in-situ replacement of all secondary systems assets at Deniliquin substation; and
- > **Option 3** – strategic asset replacement involving individual replacement of identified assets up to 2023.

No submissions were received in response to this PSCR and no additional credible options have been identified.

TransGrid expects coronavirus (COVID-19) to impact its suppliers and disrupt their supply chains. TransGrid has preliminary advice that this is already occurring, although at this time the extent of the current or future impact is unknown. Consequently, some of the costs associated with the works outlined in this document may be affected.

All costs presented in this PACR are in 2019/20 dollars.

3.1 Base case

The costs of each option in this PACR were compared against those of a base case²⁰. Under this base case, no proactive capital investment is made to remediate the technological obsolescence, spares unavailability, discontinued manufacturer support, and components deterioration of the secondary systems. The asset will continue to operate and be maintained under the current regime.

Annual operating and maintenance costs are approximately \$6,000. However, increases to the regular maintenance regime will not be able to mitigate the risk of failure of the secondary systems at Deniliquin substation due to technology obsolescence and reduced reliability.

The table below provides a breakdown of the operating expenditure under the base case.

Table 3-1 Operating expenditure breakdown under the base case (\$ 2019/20)

Item	Operating expenditure (\$)
Annualised protection maintenance activities	6,000
Total operating cost	6,000 (+/-25%)

²⁰ As per the RIT-T Application Guidelines, the base case provides a clear reference point for comparing the performance of different credible options. Australian Energy Regulator. "Application guidelines Regulatory Investment Test for Transmission - December 2018." Melbourne: Australian Energy Regulator, 2018. Accessed 1 August 2019. 22. https://www.aer.gov.au/system/files/AER%20-%20Final%20RIT-T%20application%20guidelines%20-%2014%20December%202018_0.pdf

The majority of protection relays, remote control and monitoring devices at this site have limited spares, no manufacturer support, and will reach end of serviceable life by 2022/23. Repairs will become more difficult due to limited spares and this will lead to increasing risk of asset failure, difficulty to repair any failures, likelihood of a hazardous event occurring and periods of unavailability.

TransGrid calculates the annual safety, environmental and operational risk costs associated with the Deniliquin substation secondary systems under the base case to be approximately \$1.5m.²¹

3.2 Option 1 – Secondary Systems Buildings replacement

Option 1 involves a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular SSB and installing new cables throughout. This option will modernise the automation philosophy to current design standards and practices.

This option assumes that the new secondary systems will be designed to be accommodated within a similar panel arrangement as the existing installation. Redundant panels and tunnel boards in the existing Auxiliary Services Building’s (ASB) relay room will need to be progressively decommissioned and removed as the new secondary systems are cut-over and commissioned.

The work will be undertaken over the three-year period with all works expected to be completed by 2022/23.

All works under all options will be completed in accordance with the relevant standards and components shall be replaced to have minimal modification to the wider transmission network.

Necessary outages of relevant assets in service will be planned appropriately in order to complete the works with minimal impact on the network.

The estimated capital expenditure associated with this option is \$11.0 million +/- 25 per cent. The table below provides a breakdown.

Table 3-2 Capital expenditure breakdown under Option 1 (\$m 2019/20)

Item	Capital expenditure (\$m)
FY20	1.2
FY21	0.2
FY22	3.2
FY23	6.4
Total capital cost (Complete renewal with SSB)	11.0 (+/-25%)

Routine operating and maintenance costs are approximately \$4,000 per year. The table below provides a breakdown.

²¹ This determination of yearly risk costs is based on TransGrid’s Network Asset Risk Assessment Methodology and incorporates variables such as likelihood of failure/exposure, various types of consequence costs and corresponding likelihood of occurrence.

Table 3-3 Operating expenditure breakdown under Option 1 (\$ 2019/20)

Item	Operating expenditure (\$)
Annualised protection maintenance activities	4,000
Total operating cost	4,000 (+/- 25%)

TransGrid calculates the annual safety, environmental and operational risk costs associated with the Deniliquin substation secondary systems under Option 1 to be approximately \$1,000.²²

3.3 Option 2 – Complete in-situ (on-site) replacement of protection and control systems

Option 2 involves replacement of all secondary systems assets at Deniliquin substation whilst retaining the existing building and cables. This option will modernise the automation philosophy to current design standards and practices. This option also includes replacement of Direct Current (DC) supplies to account for an increase in secondary systems power requirements and remediation of the 415V Alternating Current (AC) distribution in the building and the switchyard.

Note:

1. This option cannot address the risks posed by the existing substandard cabling as it is not feasible to replace the existing cables in-situ due to space constraints. Replacing cables in-situ requires the installation of the new cables with the existing cables prior to cut-over. This doubles the volume of cables from the switchyard into the existing building.
2. The implementation of this option will require remediation works and future maintenance of the existing building. An initial structural inspection was undertaken in June 2019 to provide a more detailed understanding of the overall condition of the existing building at Deniliquin substation. The foundation of the existing building was found to be defective and requires remediation. The cost of the remediation work is currently not included as costly and time consuming invasive inspection is required to determine the extent of works. This represents an underestimate of the capital cost of this option.

The work will be undertaken over the three-year period with all works expected to be completed by 2022/23.

All works under all options will be completed in accordance with the relevant standards and components shall be replaced to have minimal modification to the wider transmission network. Necessary outages of relevant assets in service will be planned appropriately in order to complete the works with minimal impact on the network.

The estimated capital expenditure associated with this option is \$4.7 million +/- 25 per cent. The table below provides a breakdown.

²² This determination of yearly risk costs is based on TransGrid's Network Asset Risk Assessment Methodology and incorporates variables such as likelihood of failure/exposure, various types of consequence costs and corresponding likelihood of occurrence.

Table 3-4 Capital expenditure breakdown under Option 2 (\$m 2019/20)

Item	Capital expenditure (\$m)
FY21	0.1
FY22	2.1
FY23	2.5
Total capital cost (Complete renewal of assets)	4.7 (+/- 25%)

Routine operating and maintenance costs are approximately \$4,000 per year. The table below provides a breakdown.

Table 3-5 Operating expenditure breakdown under Option 2 (\$ 2019/20)

Item	Operating expenditure (\$)
Annualised protection maintenance activities	4,000
Total operating cost	4,000 (+/- 25%)

TransGrid calculates the annual safety, environmental and operational risk costs associated with the Deniliquin substation secondary systems to be approximately \$676,000.²³

3.4 Option 3 – Strategic asset replacement

Option 3 involves individual replacements of identified assets in the existing building up to 2024 whilst retaining the existing building and cables. The option is based on a like-for-like approach whereby the asset is replaced by its modern equivalent. Additional system modifications or additional functionalities would not be deployed under this option. This option will lock TransGrid to a system architecture that cannot be expanded to match modern technology capabilities into the future.

Note:

1. This option cannot address the risks posed by the existing substandard cabling as it is not feasible to replace the existing cables in-situ due to space constraints. Replacing cables in-situ requires the installation of the new cables with the existing cables prior to cut-over. This doubles the volume of cables from the switchyard into the existing building.
2. The implementation of this option will require remediation works and future maintenance of the existing building. An initial structural inspection was undertaken in June 2019 to provide a more detailed understanding of the overall condition of the existing building at Deniliquin substation. The foundation of the existing building was found to be defective and requires remediation. The cost of the remediation work is currently not included as costly and time consuming invasive inspection is required to determine the extent of works. This represents an underestimate of the capital cost of this option.

All works under all options will be completed in accordance with the relevant standards and components shall be replaced to have minimal modification to the wider transmission network.

Necessary outages of relevant assets in service will be planned appropriately in order to complete the works with minimal impact on the network.

²³ This determination of yearly risk costs is based on TransGrid's Network Asset Risk Assessment Methodology and incorporates variables such as likelihood of failure/exposure, various types of consequence costs and corresponding likelihood of occurrence.

The estimated capital expenditure associated with this option is approximated at \$3.1 million by 2022/23. A further \$600,000 is estimated in 2024/25. The table below provides a breakdown.

Table 3-6 Capital expenditure breakdown under Option 3 (\$m 2019/20)

Item	Capital expenditure (\$m)
FY20	0.4
FY21	0.9
FY22	0.9
FY23	0.9
FY25	0.6
Total capital cost (Renewals)	3.7 (+/- 25%)

Routine operating and maintenance costs are approximately \$4,000 per year. The table below provides a breakdown.

Table 3-7 Operating expenditure breakdown under Option 3 (\$ 2019/20)

Item	Operating expenditure (\$)
Annualised protection maintenance activities	4,000
Total operating cost	4,000 (+/- 25%)

TransGrid calculates the annual safety, environmental and operational risk costs associated with the Deniliquin substation secondary systems to be approximately \$1.4m.²⁴

3.5 No material inter-network impact is expected

TransGrid has considered whether the credible options listed above is expected to have material inter-regional impact.²⁵ A 'material inter-network impact' is defined in the NER as:

“A material impact on another Transmission Network Service Provider’s network, which impact may include (without limitation): (a) the imposition of power transfer constraints within another Transmission Network Service Provider’s network; or (b) an adverse impact on the quality of supply in another Transmission Network Service Provider’s network.”

AEMO’s suggested screening test to indicate that a transmission augmentation has no material inter-network impact if it satisfies the following:²⁶

- > a decrease in power transfer capability between transmission networks or in another TNSP’s network of no more than the minimum of 3 per cent of the maximum transfer capability and 50 MW
- > an increase in power transfer capability between transmission networks or in another TNSP’s network of no more than the minimum of 3 per cent of the maximum transfer capability and 50 MW

²⁴ This determination of yearly risk costs is based on TransGrid’s Network Asset Risk Assessment Methodology and incorporates variables such as likelihood of failure/exposure, various types of consequence costs and corresponding likelihood of occurrence.

²⁵ As per clause 5.16.4(b)(6)(ii) of the NER.

²⁶ Inter-Regional Planning Committee. “Final Determination: Criteria for Assessing Material Inter-Network Impact of Transmission Augmentations.” Melbourne: Australian Energy Market Operator, 2004. Appendix 2 and 3. Accessed 15 March 2019. <https://www.aemo.com.au/-/media/Files/PDF/170-0035-pdf>

- > an increase in fault level by less than 10 MVA at any substation in another TNSP's network
- > the investment does not involve either a series capacitor or modification in the vicinity of an existing series capacitor.

TransGrid notes that each credible option satisfies these conditions as it does not modify any aspect of electrical or transmission assets. By reference to AEMO's screening criteria, there is no material inter-network impacts associated with any of the credible options considered.

3.6 Non-network options

In the PSCR, TransGrid noted that non-network solutions will not enable TransGrid to continue meeting its Rules obligation under Schedule 5.1 and clause 4.11 of the NER to provide redundant secondary systems and ensure that the transmission system is adequately protected. Notwithstanding, as part of this consultation process, interested parties were able to make submissions regarding non-network options that satisfy, or contribute to satisfying, the identified need.

TransGrid did not receive any responses from proponents of non-network options to the PSCR.

3.7 Options considered but not progressed

TransGrid determines that there is no other commercially and technically feasible option to meet the identified need.

4. Materiality of market benefits

This section outlines the categories of market benefits prescribed in the NER and whether they are considered material for this RIT-T.²⁷

4.1 Wholesale electricity market benefits are not material

The AER has recognised that if the credible options considered will not have an impact on the wholesale electricity market, then a number of classes of market benefits will not be material in the RIT-T assessment, and so do not need to be estimated.²⁸

TransGrid determines that the credible options considered in this RIT-T will not address network constraints between competing generating centres and are therefore not expected to result in any change in dispatch outcomes and wholesale market prices. TransGrid therefore considers that the following classes of market benefits are not material for this RIT-T assessment:

- > changes in fuel consumption arising through different patterns of generation dispatch
- > changes in voluntary load curtailment (since there is no impact on pool price)
- > changes in costs for parties other than the RIT-T proponent
- > changes in ancillary services costs
- > changes in network losses
- > competition benefits
- > Renewable Energy Target (RET) penalties.

4.2 No other classes of market benefits are material

In addition to the classes of market benefits listed above, NER clause 5.16.1(c)(4) requires TransGrid to consider the following classes of market benefits in relation to each credible option: differences in the timing of transmission investment; option value; and changes in involuntary load shedding. TransGrid considers that none of the classes of market benefits listed are material for this RIT-T assessment for the reasons in Table 4-1.

Table 4-1 Reasons non-wholesale electricity market benefits are considered immaterial

Market benefits	Reason
Changes in involuntary load shedding	A failure of secondary system element results in an extremely low chance of unserved energy.

²⁷ The NER requires that all classes of market benefit identified in relation to the RIT-T are included in the RIT-T assessment, unless the TNSP can demonstrate that a specific class (or classes) is unlikely to be material in relation to the RIT-T assessment for a specific option – NER clause 5.16.1(c)(6). See Appendix A for requirements applicable to this document.

²⁸ Australian Energy Regulator. "Application guidelines Regulatory Investment Test for Transmission - December 2018." Melbourne: Australian Energy Regulator, 2018.39. Accessed 15 March 2019. https://www.aer.gov.au/system/files/AER%20-%20Final%20RIT-T%20application%20guidelines%20-%202014%20December%202018_0.pdf

Market benefits	Reason
Differences in the timing of expenditure	<p>Options considered are unlikely to affect decisions to undertake unrelated expenditure in the network. Consequently, material market benefits will neither be gained nor lost due to changes in the timing of expenditure from any of the options considered.</p> <p>Options are being undertaken to mitigate, in isolation, the rising risk caused by the existing asset nearing its end of serviceable life.</p>
Option value	<p>TransGrid notes the AER's view that option value is likely to arise where there is uncertainty regarding future outcomes, the information that is available is likely to change in the future, and the credible options considered by the TNSP are sufficiently flexible to respond to that change.²⁹</p> <p>TransGrid also notes the AER's view that appropriate identification of credible options and reasonable scenarios captures any option value, thereby meeting the NER requirement to consider option value as a class of market benefit under the RIT-T.</p> <p>TransGrid notes that no credible option is sufficiently flexible to respond to change or uncertainty.</p> <p>Additionally, a significant modelling assessment would be required to estimate the option value benefits, which would be disproportionate to potential additional benefits for this RIT-T. Therefore, TransGrid has not estimated additional option value benefit.</p>

²⁹ Australian Energy Regulator. "Application guidelines Regulatory Investment Test for Transmission - December 2018." Melbourne: Australian Energy Regulator, 2018.58-59. Accessed 15 March 2019. https://www.aer.gov.au/system/files/AER%20-%20Final%20RIT-T%20application%20guidelines%20-%2014%20December%202018_0.pdf

5. Overview of the assessment approach

This section outlines the approach that TransGrid has applied in assessing the net benefits associated with each of the credible options against the base case.

5.1 Description of the base case

The costs and benefits of each option in this document are compared against the base case. Under this base case, no investment is undertaken and TransGrid incurs regular and reactive maintenance costs, operational and safety related risks costs that are caused by the failure of secondary systems to operate when required .

TransGrid notes that this course of action is not expected in practice. However, this approach has been adopted since it is consistent with AER guidance on the base case for RIT-T applications.³⁰

5.2 Assessment period and discount rate

An outlook period of 15 year assessment period from commissioning 2022/23, from 2019/20 to 2036/37, is considered in this analysis. This period takes into account the expected asset life of secondary systems.

TransGrid adopted a central real, pre-tax 'commercial' discount rate³¹ of 5.90 per cent as the central assumption for the NPV analysis presented in this report. TransGrid considers that this is a reasonable contemporary approximation of a commercial discount rate and it is consistent with the commercial discount rate calculated in the RIT-T Economic Assessment Handbook published by Energy Networks Australia (ENA) in March 2019³².

TransGrid also tested the sensitivity of the results to discount rate assumptions. A lower bound real, pre-tax discount rate of 2.85 per cent equal to the latest AER Final Decision for a TNSP's regulatory proposal at the time of preparing this PACR³³, and an upper bound discount rate of 8.95 per cent (a symmetrical adjustment upwards) were used.

5.3 Approach to estimate option costs

TransGrid has estimated the capital costs of the options based on the scope of works necessary together with costing experience from previous projects of a similar nature. TransGrid estimates that the actual cost is within +/- 25 per cent of the central capital cost.

Routine operating and maintenance costs are based on works of similar nature.

³⁰ TransGrid notes that the final updated December 2018 AER RIT-T Guidelines state that the base case is where the RIT-T proponent does not implement a credible option to meet the identified need, but rather continues its 'BAU activities'. The AER define 'BAU activities' as ongoing, economically prudent activities that occur in the absence of a credible option being implemented. See: AER, *Regulatory Investment Test for Transmission Application Guidelines*, December 2018. 21

³¹ The use of a 'commercial' discount rate is consistent with the RIT-T and is distinct from the regulated cost of capital (or 'WACC') that applies to network businesses like TransGrid.

³² Available at <https://www.energynetworks.com.au/rit-t-economic-assessment-handbook> Note the lower bound discount rate of 2.85 per cent is based on the most recent final decision for a TNSP revenue determination which was TasNetworks in April 2019.

³³ See 2019-24 TasNetworks' Post-tax Revenue Model (PTRM) cashflow derived pre-tax real WACC available at: <https://www.aer.gov.au/networks-pipelines/determinations-access-arrangements/tasnetworks-determination-2019-24/final-decision>

5.4 Three different scenarios have been modelled to address uncertainty

The assessment was conducted under three net economic benefits scenarios. These are plausible scenarios which reflect different assumptions about the future market development and other factors that are expected to affect the relative market benefits of the options being considered. All scenarios (low, central and high) involve a number of assumptions that result in the lower bound, the expected, and the upper bound estimates for present value of net economic benefits respectively.

A summary of the key variables in each scenario is provided in the table below.

Table 5-1 Summary of scenarios

Variable / Scenario	Central	Low benefit scenario	High benefit scenario
<i>Scenario weighting</i>	50%	25%	25%
Discount rate	5.90%	8.95%	2.85%
Costs			
Network capital costs	Base estimate	Base estimate + 25%	Base estimate - 25%
Benefits (negative benefits)			
Reduction in operating and maintenance costs	Base estimate	Base estimate - 25%	Base estimate + 25%
Reduction in safety and environmental risk costs	Base estimate	Base estimate - 25%	Base estimate + 25%
Reduction in operational risks	Base estimate	Base estimate - 25%	Base estimate + 25%

TransGrid considered that the central scenario was most likely since it was based primarily on a set of expected assumptions. TransGrid therefore assigned this scenario a weighting of 50 per cent, with the other two scenarios being weighted equally with 25 per cent each.

6. Assessment of credible options

This section outlines the assessment TransGrid has undertaken of the credible network options.

The assessment compares the costs and benefits of each credible option to the base case. The benefits of each credible option are represented by reduction in costs or risks compared to the base case.

The following changes have occurred since the PSCR which have not made an impact on the preferred option:

- > changes to the discount rate for the high and low benefit scenarios used in the PSCR which was based on earlier discount rates
- > all costs have been escalated using inflation to 2019/20 dollars
- > unserved energy has been removed from the NPV analysis³⁴
- > identified potentially significant structural issues with the existing building at Deniliquin, which impacts Options 2 and 3.

However, there were no material changes since publication of the PSCR that affects the ranking preference for Option 1.

All costs presented in this PACR have been escalated using inflation and are in 2019/20 dollars.

6.1 Estimated gross benefits

The table below summarises the present value of the gross benefit estimates for each credible option relative to the base case under the three scenarios.

The benefits included in this assessment are:

- > Reduction in operation and maintenance costs
- > Reduction in safety and environmental risks
- > Reduction in operational risks³⁵

Table 6-1 Estimated gross benefits from credible options relative to the base case, present value (\$m 2019/20)

Option/scenario	Central	Low benefit scenario	High benefit scenario	Weighted
<i>Scenario weighting</i>	50%	25%	25%	
Option 1	13.0	7.6	21.3	13.7
Option 2	7.1	4.2	11.7	7.5
Option 3	0.4	0.2	0.7	0.4

³⁴ The benefits in this PACR have decreased since the PSCR due to further work on the feasibility of operational mitigations to manage reliability risk.

³⁵ There are benefits associated with operational efficiencies through greater operational visibility, remote operational switching and remote diagnostic capability.

6.2 Estimated costs

The table below summarises the capital costs of the options, relative to the base case, in present value terms. The cost has been calculated for each of the three reasonable scenarios outlined in section 0.

Table 6-2 Estimated costs of credible options relative to the base case, present value (\$m 2019/20)

Option/Scenario	Central	Low benefit scenario	High benefit scenario	Weighted value
<i>Scenario weighting</i>	50%	25%	25%	
Option 1	9.7	11.3	7.8	9.6
Option 2	4.1	4.7	3.3	4.0
Option 3	3.1	3.7	2.5	3.1

6.3 Estimated net economic benefits

The net economic benefits are the differences between the estimated gross benefits less the estimated costs. The table below summarises the present value of the net economic benefits for each credible option across the three scenarios and the weighted net economic benefits.


Table 6-3 and

Figure 6-1 show that Option 1 has the highest net economic benefit while also maintaining compliance with regulatory and safety obligations, except for the low benefit scenario where capital costs are high and benefits are low. Refer to section 6.5.2 for further details.

Table 6-3 Estimated net economic benefits relative to the base case, present value (\$m 2019/20)

Option	Central	Low benefit scenario	High benefit scenario	Weighted value	Ranking
<i>Scenario weighting</i>	50%	25%	25%		
Option 1	3.3	-3.7	13.5	4.1	1
Option 2	3.0	-0.6	8.4	3.5	2
Option 3	-2.7	-3.5	-1.8	-2.7	3

Figure 6-1 Net economic benefits, present value (\$m 2019/20)

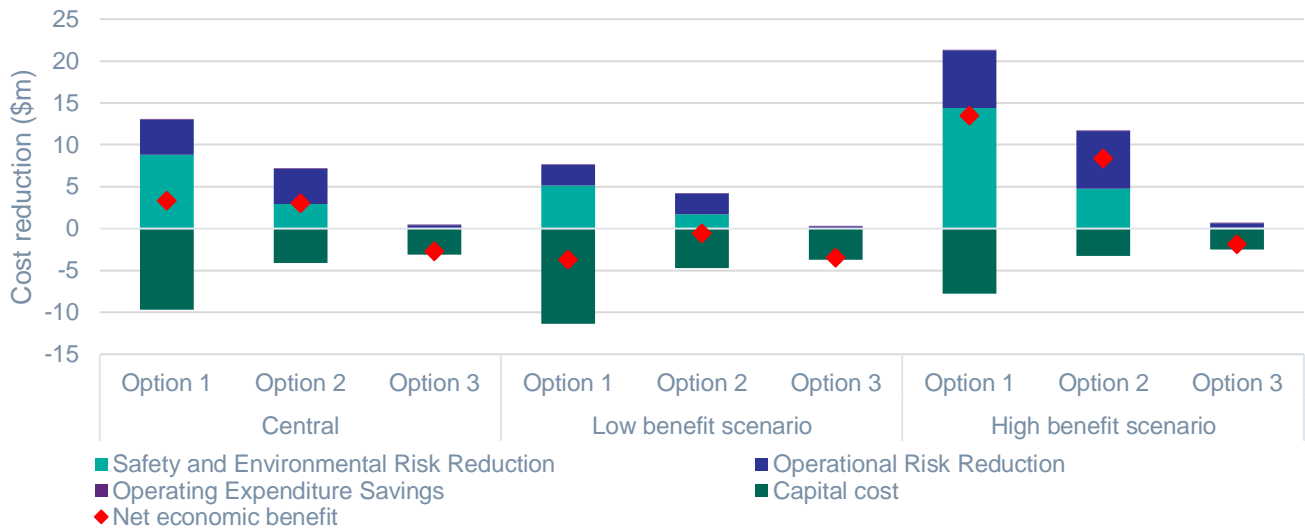

6.4 Meeting relevant regulatory obligations

Implementation of Option 1 will enable TransGrid to meet regulatory obligations set out under Schedule 5.1 and clauses 4.11.1 and 4.6.1(b)³⁶ of the NER to provide redundant secondary systems and ensure that the transmission system is adequately protected. Consequently, it will also ensure the performance standards applicable to Deniliquin substation secondary systems are met.

Implementation of Option 1 is the most efficient option to ensure reliability of the secondary systems at Deniliquin substation and mitigate its risks of prolonged failure.

³⁶ As per clause 4.6.1(b) of the NER, AEMO must ensure that there are processes in place, which will allow the determination of fault levels for normal operation of the power system and in anticipation of all credible contingency events and protected events that AEMO considers may affect the configuration of the power system, so that AEMO can identify any busbar which could potentially be exposed to a fault level which exceeds the fault current ratings of the circuit breakers associated with that busbar.

6.5 Sensitivity testing

TransGrid has undertaken a thorough sensitivity testing exercise to understand the robustness of the RIT-T assessment to underlying assumptions about key variables. In particular, TransGrid has undertaken two sets of sensitivity tests – namely:

- > Step 1 – testing the sensitivity of the optimal timing of the project ('trigger year') to different assumptions in relation to key variables
- > Step 2 – once a trigger year has been determined, testing the sensitivity of the total NPV benefit associated with the investment proceeding in that year, in the event that actual circumstances turn out to be different.

TransGrid has therefore undertaken sensitivity analysis to first determine the optimal timing of the project, to conclude that a particular year represents the 'most likely' date at which the project will be needed.

Having assumed to have committed to the project by this date, TransGrid has also looked at the consequences of 'getting it wrong' under step 2 of the sensitivity testing. That is, if expected bushfire risks are not as high as expected, for example, the impact on the net economic benefit associated with the project continuing to go ahead on that date.

The application of the two steps to test the sensitivity of the key findings is outlined below.


6.5.1 Step 1 – Sensitivity testing of the optimal timing

TransGrid has estimated the optimal timing for Option 1 based on the year in which the NPV is maximised. This process was undertaken for both the central set of assumptions and also a range of alternative assumptions for key variables. This section outlines the sensitivity of the identification of the commissioning year to changes in the underlying assumptions. In particular, the optimal timing of the option is found to be invariant to the assumptions of:

- > a 25 per cent increase/decrease in the assumed network capital costs
- > lower discount rate of 2.85 per cent as well as a higher rate of 8.95 per cent
- > lower (or higher) assumed safety and environmental risks
- > lower (or higher) assumed operational risks
- > lower (or higher) assumed operation and maintenance costs

The figure below outlines the impact on the optimal commissioning year, under a range of alternative assumptions. It illustrates that for Option 1, the optimal commissioning date is found to be in 2022/23 for all of the sensitivities investigated.

Figure 6-2 Optimal timing of Option 1

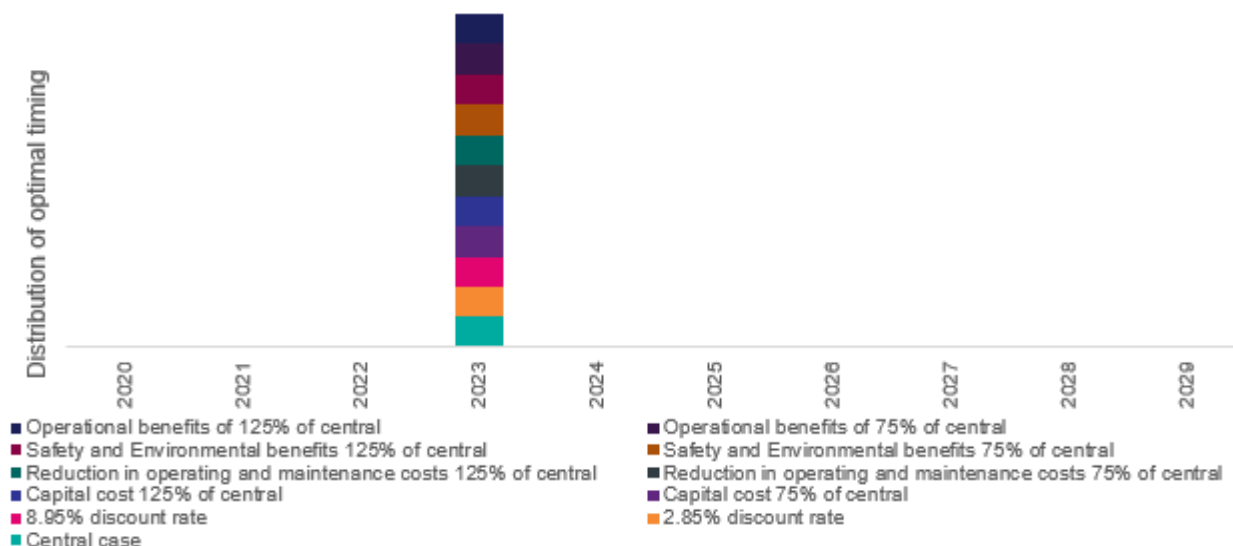

6.5.2 Step 2 – Sensitivity of the overall net benefit

TransGrid has also conducted sensitivity analysis on the overall NPV of the net economic benefit, based on the optimal option timing established in step 1. Specifically, TransGrid has investigated the same sensitivities under this second step as in the first step:






- > a 25 per cent increase/decrease in the assumed network capital costs
- > lower discount rate of 2.85 per cent as well as a higher rate of 8.95 per cent
- > lower (or higher) assumed safety and environmental risks
- > lower (or higher) assumed operational risks
- > lower (or higher) assumed operation and maintenance costs

All these sensitivities investigate the consequences of 'getting it wrong' having committed to a certain investment decision.

The figures below illustrate the estimated net economic benefits for each option if separate key assumptions in the central scenario are varied individually. Even though Option 2 delivers the most benefit under some conditions, Option 1 remains the preferred option. The most relevant scenario is increased capital cost. However, TransGrid still considers Option 1 to be superior based on:

- > Option 1 provides a larger overall safety risk reduction benefit over Options 2 and 3. This is because Options 2 and 3 cannot address the risks posed by the existing substandard cabling as it is not feasible to replace the cables in-situ due to space constraints. The capital cost difference between Option 1 and Options 2 and 3 is driven by cabling costs.
- > Subsequent to the publication of the PSCR, potentially significant structural issues with the existing building at Deniliquin substation was identified. The cost of building remediation works is currently not included in Options 2 and 3 as costly and time consuming invasive inspection is required to determine the extent of works. This is a conservative approach as it underestimates the capital cost for Options 2 and 3. Inclusion of the building remediation cost to the current cost estimate for Options 2 and 3 will only strengthen the position of Option 1 as the preferred option.

Figure 6-3 Sensitivities

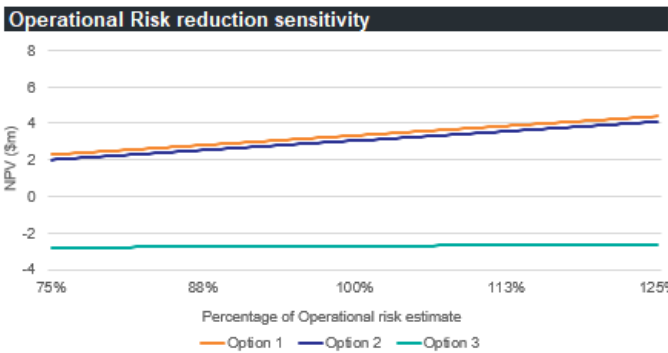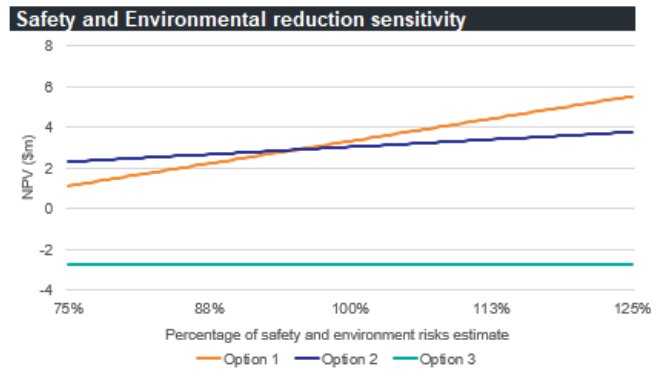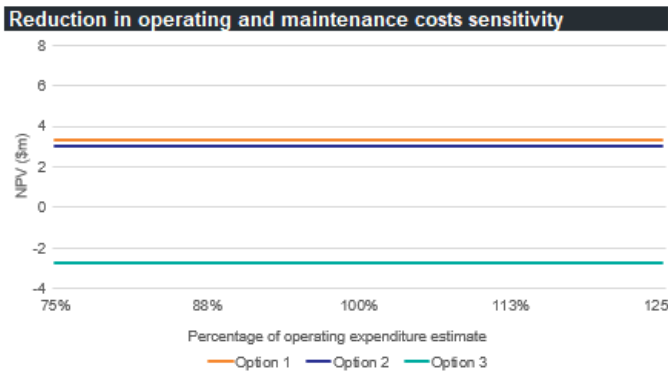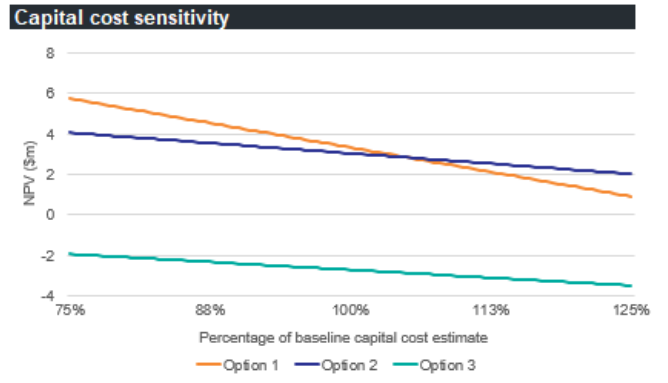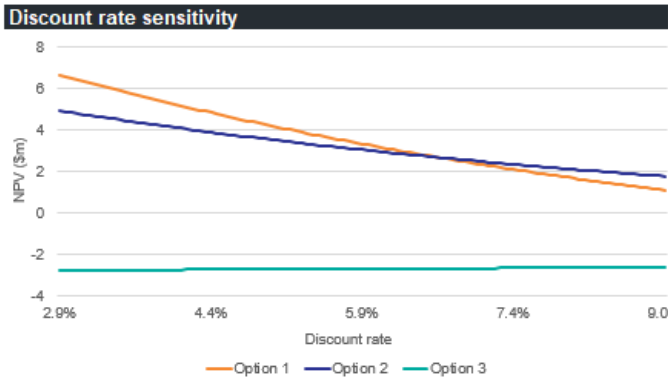

7. Final conclusion on the preferred option

The optimal commercially and technically feasible option presented in the PSCR – Option 1 (a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular SSB and installing new cables throughout) – remains the preferred option to meet the identified need. Option 1 can be implemented in sufficient time to meet the identified need by 2022/23, and is therefore the preferred option presented in this PACR.

Option 1 is the most prudent and economically efficient solution to enable TransGrid to continue meeting its regulatory obligations set out in clauses 4.11.1, 4.6.1(b),³⁷ and Schedule 5.1 of the NER. Consequently, it will ensure the performance standards applicable to Deniliquin substation secondary systems are met.

Option 1 involves a complete upgrade and renewal of secondary systems at Deniliquin substation by using modular SSB and installing new cables throughout.

The works will be undertaken between 2019/20 and 2022/23. Planning and procurement (including completion of the RIT-T) will occur between 2018/19 and 2019/20, while the procurement and delivery of the identified assets is planned to occur prior to 2020/21 and all works will be completed by 2022/23. Necessary outages of relevant assets in service will be planned appropriately in order to complete the works with minimal impact on the network.

The estimated capital cost of this option is approximately \$11.0 million. Routine and operating maintenance costs are approximately \$4,000 per year. The analysis undertaken and the identification of Option 1 as the preferred option satisfies the RIT-T.

³⁷ As per clause 4.6.1(b) of the NER, AEMO must ensure that there are processes in place, which will allow the determination of fault levels for normal operation of the power system and in anticipation of all credible contingency events and protected events that AEMO considers may affect the configuration of the power system, so that AEMO can identify any busbar which could potentially be exposed to a fault level which exceeds the fault current ratings of the circuit breakers associated with that busbar.

Appendix A – Compliance checklist

This section sets out a checklist which demonstrates the compliance of this PACR with the requirements of the National Electricity Rules version 138.

Rules clause	Summary of requirements	Relevant section
5.16.4(v)	The project assessment conclusions report must set out:	–
	(1) the matters detailed in the project assessment draft report as required under paragraph (k); and	See below.
	(2) a summary of, and the RIT-T proponent's response to, submissions received, if any, from <i>interested parties</i> sought under paragraph (q).	NA
5.16.4(k)	The project assessment draft report must include:	–
	(1) a description of each credible option assessed;	3
	(2) a summary of, and commentary on, the submissions to the project specification consultation report;	NA
	(3) a quantification of the costs, including a breakdown of operating and capital expenditure, and classes of material market benefit for each credible option;	3, 4
	(4) a detailed description of the methodologies used in quantifying each class of material market benefit and cost;	5
	(5) reasons why the RIT-T proponent has determined that a class or classes of market benefit are not material;	4
	(6) the identification of any class of market benefit estimated to arise outside the <i>region</i> of the <i>Transmission Network Service Provider</i> affected by the RIT-T project, and quantification of the value of such market benefits (in aggregate across all regions);	3, 4
	(7) the results of a net present value analysis of each credible option and accompanying explanatory statements regarding the results;	6
	(8) the identification of the proposed preferred option;	7
(9) for the proposed preferred option identified under subparagraph (8), the RIT-T proponent must provide:	3, 7	
(i) details of the technical characteristics;		
(ii) the estimated construction timetable and commissioning date;		
(iii) if the proposed preferred option is likely to have a <i>material inter-network impact</i> and if the <i>Transmission Network Service Provider</i> affected by the RIT-T project has received an augmentation technical report, that report; and		
(iv) a statement and the accompanying detailed analysis that the preferred option satisfies the <i>regulatory investment test for transmission</i> .		

Appendix B – Assumptions underpinning the identified need

This appendix summarises the key assumptions and data from the risk assessment methodology that underpin the identified need for this RIT-T and the assessment undertaken for the Revenue Proposal.³⁸

As part of preparing its Revenue Proposal for the current regulatory control period, TransGrid developed the Network Asset Risk Assessment Methodology to quantify risk for replacement and refurbishment projects. The risk assessment methodology:


- > uses externally verifiable parameters to calculate asset health and failure consequences
- > assesses and analyses asset condition to determine remaining life and probability of failure
- > applies a worst-case asset failure consequence and significantly moderates this down to reflect the likely consequence in a particular circumstance
- > identifies safety and compliance obligations with a linkage to key enterprise risks.

B.1 Overview risk assessment methodology

A fundamental part of the risk assessment methodology is calculating the ‘risk costs’ or the monetised impacts of the reliability, safety, environmental and other risks.

Figure B-1 below summarises the framework for calculating the ‘risk cost’, which has been applied on TransGrid’s asset portfolio considered to need replacement or refurbishment.

Figure B-1 Overview of TransGrid’s ‘risk cost’ framework

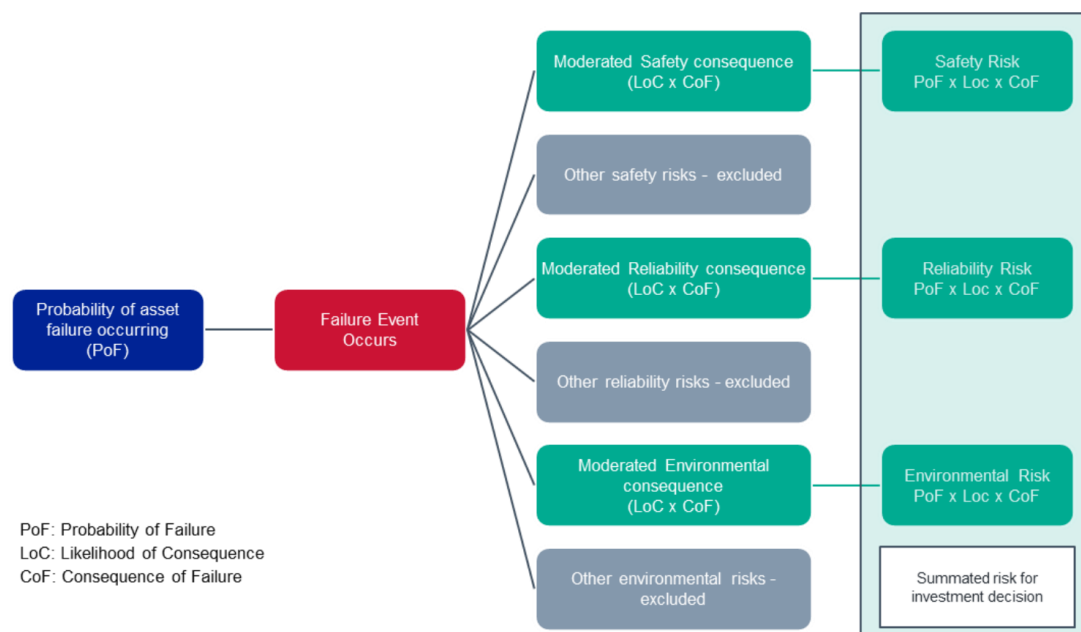

The ‘risk costs’ are calculated based on the Probability of Failure (PoF), the Consequence of Failure (CoF), and the corresponding Likelihood of Consequence (LoC).

In calculating the PoF, each failure mode that could result in significant impact is considered. For replacement

³⁸ For additional information on the risk assessment methodology, refer to pages 63-69 of TransGrid’s Revised Regulatory Proposal for the period 2018-23, available at: <https://www.aer.gov.au/system/files/TransGrid%20-%20Revised%20Revenue%20Proposal%20-%20201%20December%202017.pdf>

planning, only life-ending failures are used to calculate the risk costs. PoF is calculated for each failure mode based on 'conditional age' (health-adjusted chronological age), failure and defect history, and benchmarking studies. For 'wear out' failures, a Weibull curve may be fitted; while for random failures, a static failure rate may be used.

In calculating the CoF, LoC and risks, TransGrid uses a moderated 'worst case' consequence. This is an accepted approach in risk management and ensures that high impact, low probability (HILP) events are not discounted. The approach excludes the risk costs of low impact, high probability (LIHP) which would result in lower calculated risk.